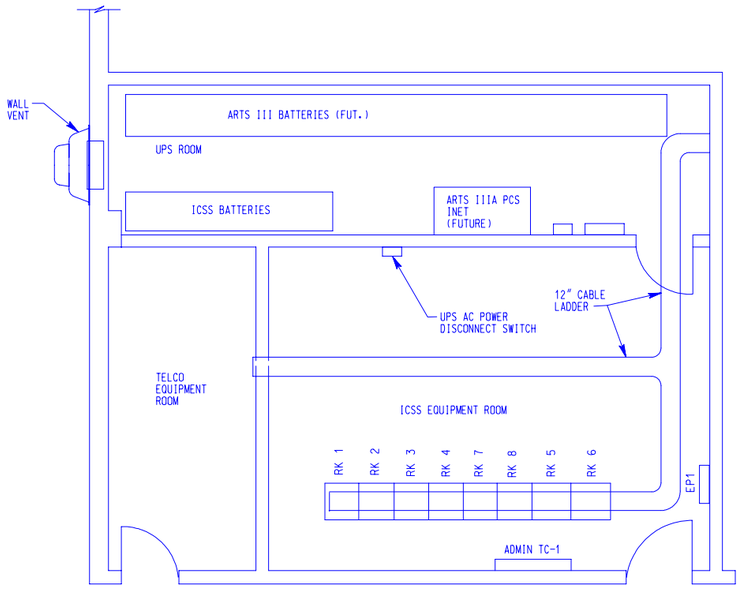

NOTE

1. FAA DEMARCATION BLOCKS AND FAA/ICSS INTERFACE MOUNTED ON WALL IN TERMINAL CABINET.

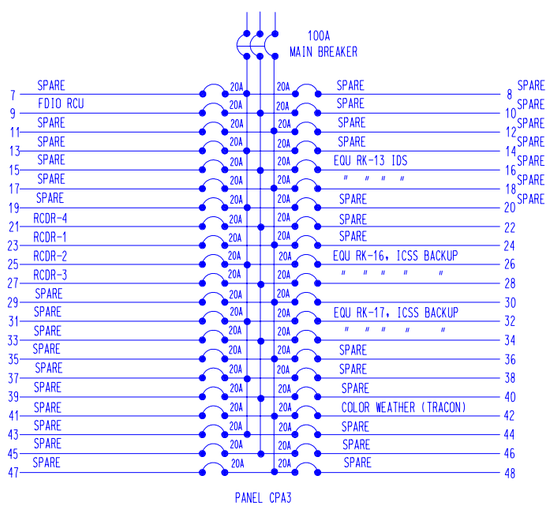

NOTE

ICSS UPS BREAKER PANEL
ER1--26 CKT BREAKER
ER1-2-28 CKT BREAKER
ER2-1-36 CKT BREAKER
ER2-2-32 CKT BREAKER
ER3-1-34 CKT BREAKER

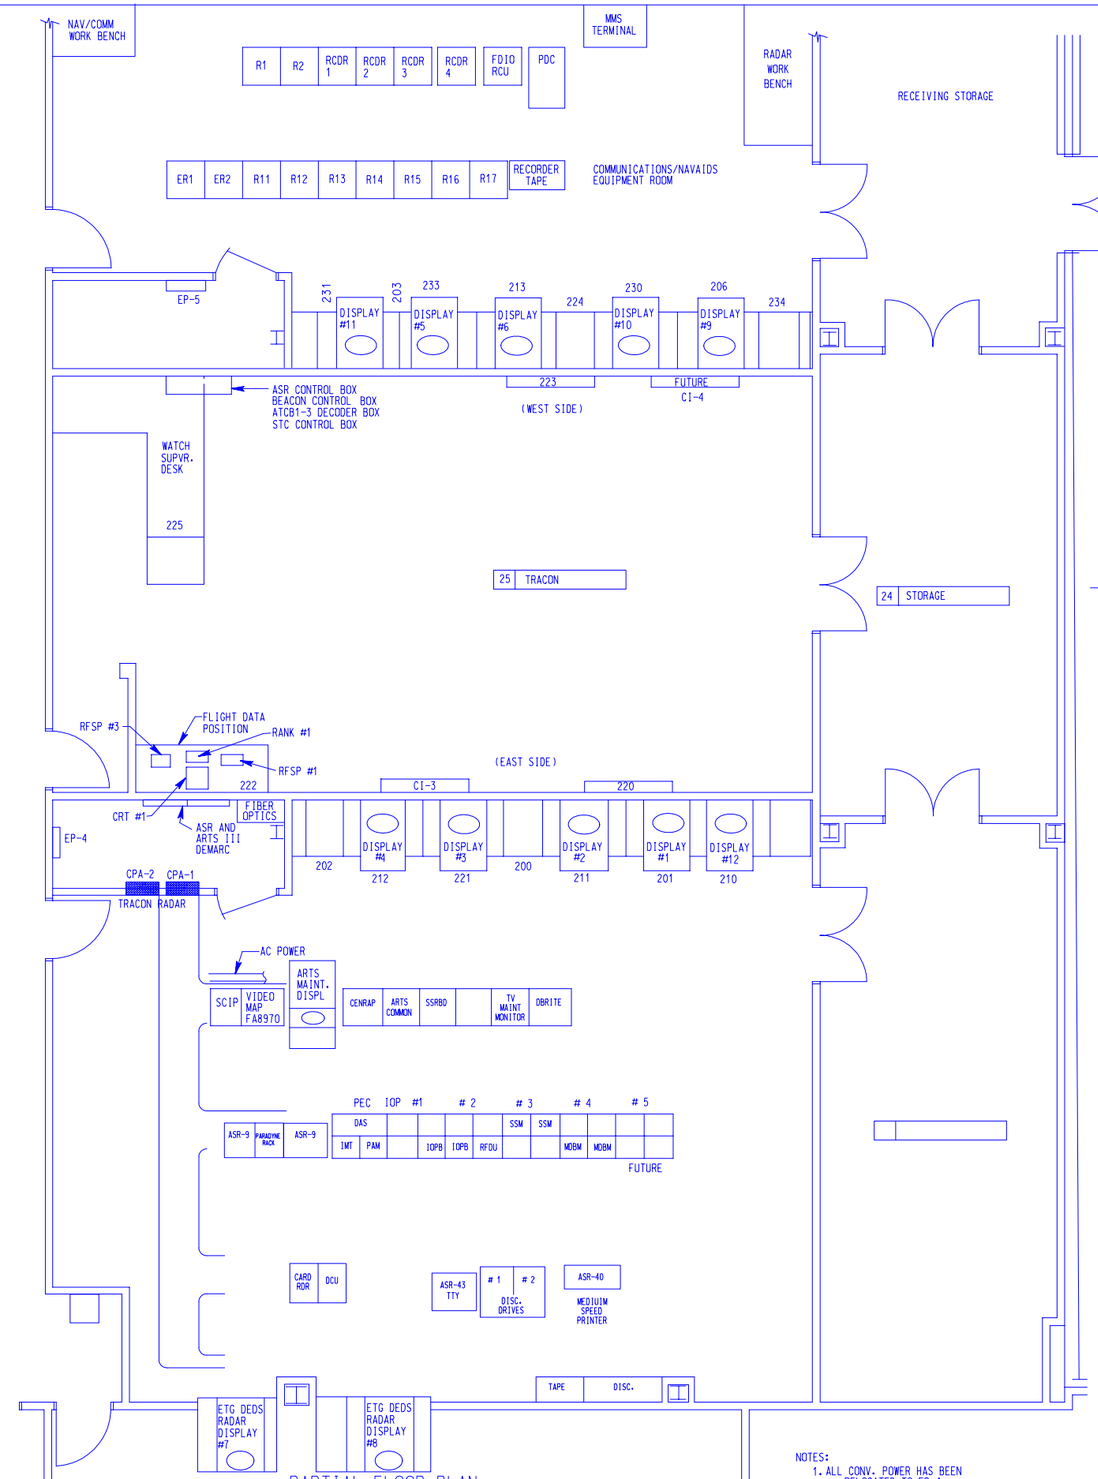

PARTIAL FLOOR PLAN

4 0 4 8 12

SCALE IN FEET
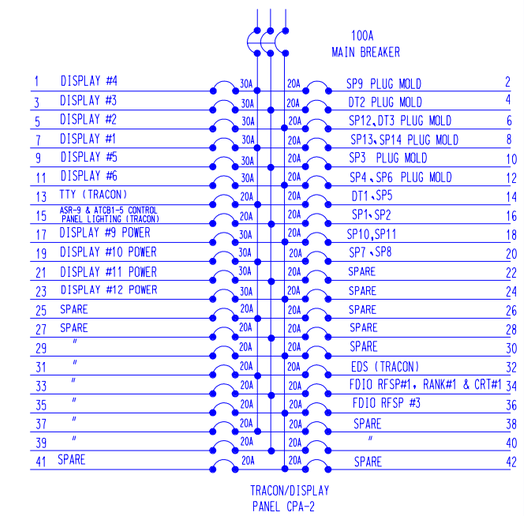
NOTES:
1. ALL CONV. POWER HAS BEEN RELOCATED TO EP-4