

APP CRS	Rwy Idg	8500
309°	TDZE	430
	Apt Elev	477

RNAV (RNP) Y RWY 31L
PALM SPRINGS INTL (PSP)

RNP AR APCH.

T
A Missed approach requires minimum climb of 340' per NM to 3000. For uncompensated Baro-VNAV systems, procedure NA below 2°C or above 54°C.

MISSED APPROACH: Climb to 1800, then climbing right turn to 4000 direct TRM VORTAC and hold.


ATIS
124.65

SOCAL APP CON
126.7 370.95
135.275 251.1

PALM SPRINGS TOWER★
119.7 (CTAF) 377.05

GND CON
121.9

CLNC DEL
128.35

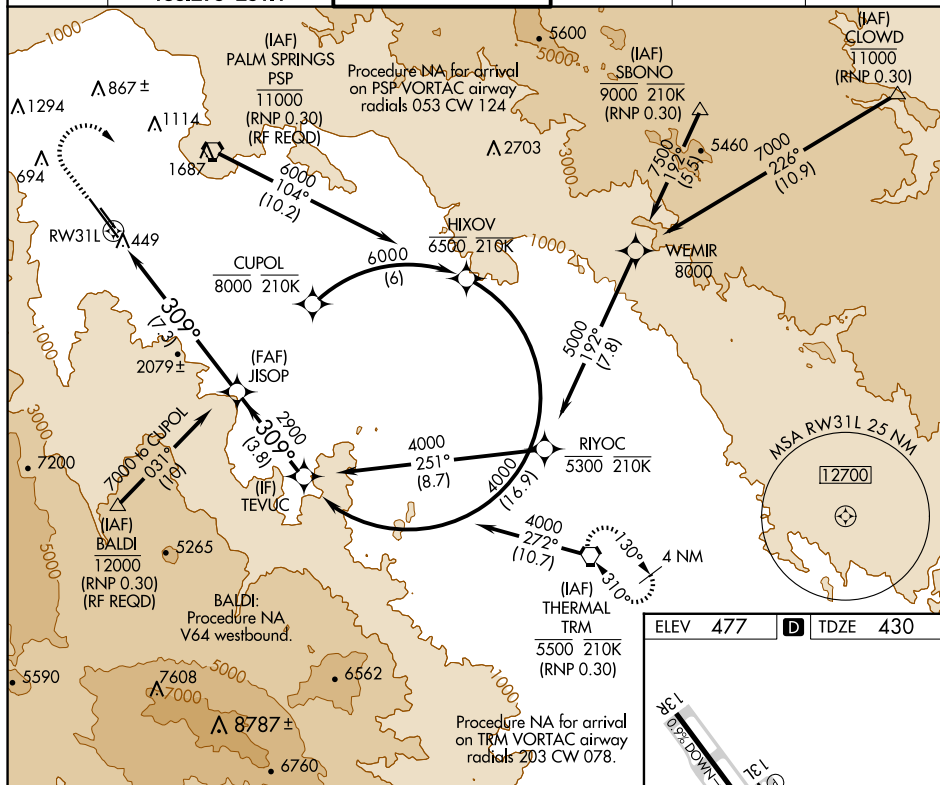UNICOM
122.95

SW-3, 20 MAR 2025 to 17 APR 2025

SW-3, 20 MAR 2025 to 17 APR 2025

1800	4000	TRM
		


Final approach course offset 1.1°



CATEGORY	A	B	C	D
RNP 0.30 DA	734-1 304 (300-1)			

AUTHORIZATION REQUIRED

ELEV	477	D	TDZE	430
------	-----	----------	------	-----

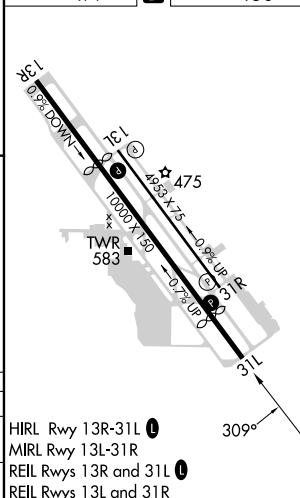

PALM SPRINGS, CALIFORNIA

Amdt 1C 05DEC19

33°50'N-116°30'W

Palm Springs Intl (PSP)

RNAV (RNP) Y RWY 31L