

WAAS CH 93535 W30A	APP CRS 296°	Rwy Idg 10000 TDZE 9 Apt Elev 9
--	------------------------	--

RNAV (GPS) Y RWY 30
SAN FRANCISCO BAY OAKLAND INTL (OAK)


T For uncompensated Baro-VNAV systems, LNAV/VNAV NA below 1°C (34°F) or above 54°C (130°F). DME/DME RNP-0.3 NA. For inop ALS, increase LNAV/VNAV all Cats visibility to RVR 4500 and LNAV Cat C/D visibility to 1½ SM.

ALSF-2



MISSED APPROACH: Climb to 4000 direct PLAZA and on track 282° to SAU VOR/DME and hold, continue climb-in-hold to 4000.

D-ATIS 133.775	NORCAL APP CON 125.35 263.15	OAKLAND TOWER 118.3 291.65 (Rwys 10L/R-28L/R, 15-33) 127.2 256.9 (Rwy 12-30)	GND CON 121.9 (Rwys 10L/R-28L/R, 15-33) 121.75 (Rwy 12-30)	CLNC DEL 121.1	CPDLC
--------------------------	--	--	--	--------------------------	-------

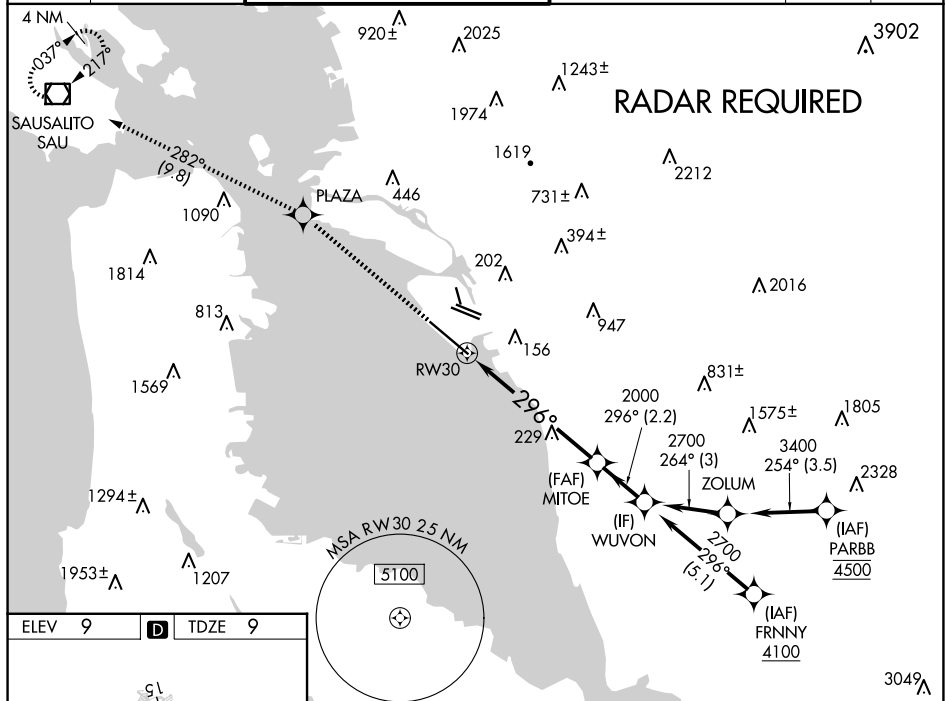

Category	A	B	C	D
LPV DA	209/18	200 (200-½)		
LNNAV/VNAV DA	283/24	274 (300-½)		
LNNAV MDA	580/24	571 (600-½)	580-1¼	571 (600-1¼)
CIRCLING	580-1	571 (600-1)	660-1¾ 651 (700-1¾)	1400-3 1391 (1400-3)