



WAAS CH 78144	APP CRS 053°	Rwy Idg TDZE 716	7543
W05A		Apt Elev 716	

RNAV (GPS) RWY 5

WILLOW RUN (YIP)

RNP APCH - GPS.	MALSR	MISSED APPROACH: Climb to 1200 then climbing left turn to 3000 direct SVM VORTAC and hold.
▼ For uncompensated Baro-VNAV systems, LNAV/VNAV NA below -19°C or above 54°C. For inop ALS, increase LNAV/VNAV all Cats visibility to RVR 6000, LNAV Cats C/D visibility to 1 3⁄8 SM.		

ATIS 127.425	DETROIT APP CON 118.95 284.0	WILLOW RUN TOWER 125.275 256.9	GND CON 119.975
------------------------	--	--	---------------------------

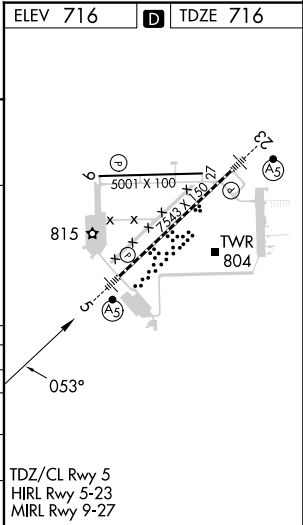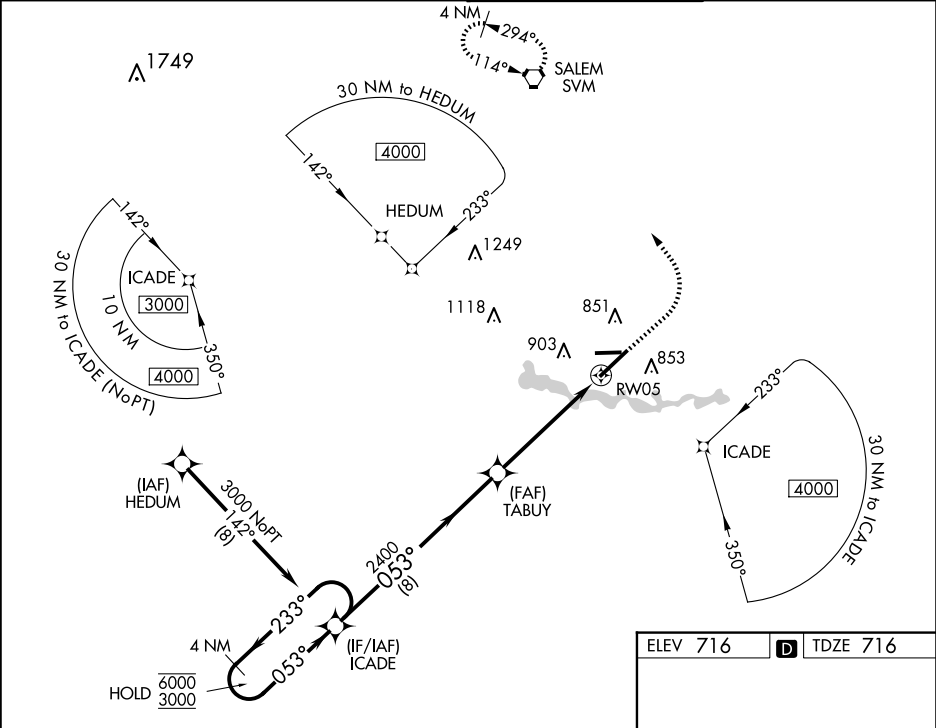

4 NM Holding Pattern	VGSI and RNAV glidepath not coincident (VGSI Angle 3.00/TCH 75).	1200	3000	SVM
ICADE	TABUY	2400	1.2 NM to RW05	
6000 ← 233°	3000 → 053°	2400	8 NM	3.9 NM
GP 3.00° TCH 59				
CATEGORY	A	B	C	D
LPV DA	916/18 200 (200-½)			
LNAV/VNAV DA	1121/40 405 (500-¾)			
LNAV MDA	1200/24	484 (500-½)	1200/50	484 (500-1)
CIRCLING	1220-1	504 (600-1)	1220-1½	1400-2¼
			504 (600-½)	684 (700-2¼)