
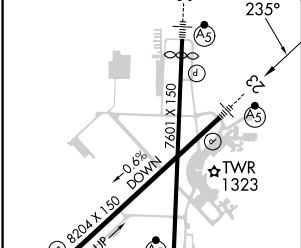


WAAS CH 90220 W23A	APP CRS 235°	Rwy Idg TDZE 1226 Apt Elev 1226
--	------------------------	---

RNAV (GPS) RWY 23
AKRON-CANTON RGNL (CAK)

⚠ For uncompensated Baro-VNAV systems, LNAV/VNAV NA below -17°C (2°F) or above 46°C (114°F). DME/DME RNP-0.3 NA. For inoperative MALSR, increase LNAV Cat D visibility to RVR 6000. ** RVR 1800 authorized with use of FD or AP or HUD to DA.	MALSR 	MISSED APPROACH: Climb to 3000 direct CICEE and on track 147° to BSV VOR/DME and hold.
---	---	--

ATIS 121.05	CLEVELAND APP CON* 125.5 269.25	AKRON-CANTON TOWER 134.75 279.575	GND CON 121.7 348.6	CLNC DEL 132.05
-----------------------	---	---	-------------------------------	---------------------------

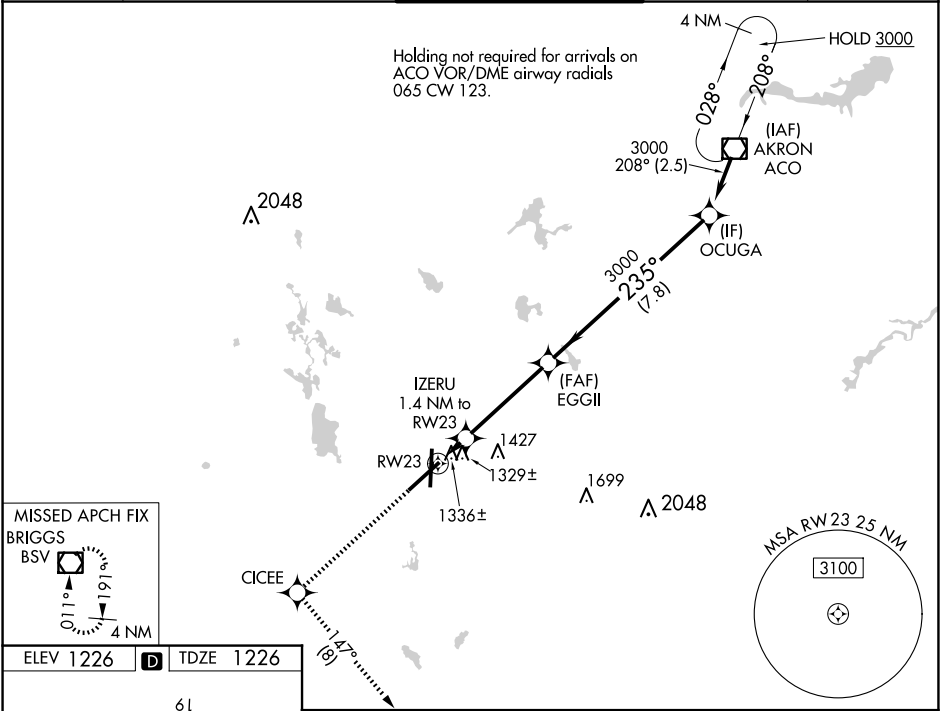

3000	CICEE	tr 147°	BSV	Procedure Turn NA	
*LNAV only					
IZERU 1.4 NM to RW23					
RW23					
*1700					
EGGII 3000					
OCUGA 3000					
GP 3.00° TCH 45					
CATEGORY	A		B	C	D
LPV DA**	1426/24 200 (200-½)				
LNAV/VNAV DA	1691/60 465 (500-1¼)				
LNAV MDA	1640/24	414 (500-½)	1640/40 414 (500-¾)	1640/50 414 (500-1)	
CIRCLING	1760-1	534 (600-1)	1780-1½ 554 (600-1½)	1800-2 574 (600-2)	

HIRL Rwy 1-19 and 5-23