

APP CRS 024°	Rwy Idg TDZE Apt Elev	6995 55 55
------------------------	-----------------------------	---------------------------------------

RNAV (RNP) Z RWY 2

RNP AR APCH - GPS.

T For uncompensated Baro-VNAV systems, procedure NA below 14°C or above 54° C. When local altimeter setting not received, procedure NA. For inop ALS, increase RNP 0.30 all Cats visibility to $\frac{2}{3}$ SM.

MALS



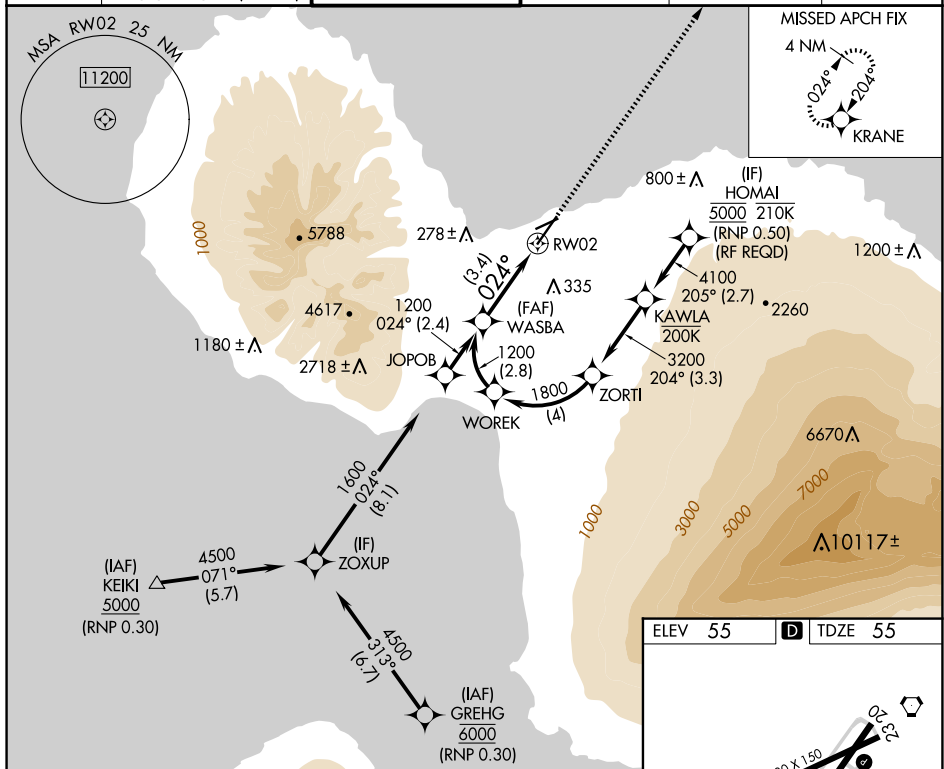
MISSED APPROACH: Climb to 3000
direct KRANE and hold.

ATIS 128.6	HCF APPROACH 120.2 322.4 (NORTH) 119.5 225.4 (SOUTH)
----------------------	--

MAUI TOWER ★
118.7 (CTAF) **Q** 279.6

GND CON
121.9 279.6

CLNC DEL
120,6 290,5

UNICOM
122.95

WASBA

1200

1200

GP 3.00°
TCH 62

024°

3.4 NM

RW02

VGSI and RNAV glidepath not coincident
(VGSI Angle 3.00/TCH 77).

See planview for multiple IF locations.

CATEGORY	A	B	C	D
RNP 0.30 DA	394-½ 339 (400-½)			

AUTHORIZATION REQUIRED

KAHULUI (OGG)(PHOG)
RNAV (RNP) Z RWY 2