

WAAS CH 70329 W08A	APP CRS 078°	Rwy Idg 10200 TDZE 936 Apt Elev 944
--	------------------------	--

RNAV (GPS) Y RWY 8R


ONTARIO INTL (ONT)

▼

For uncompensated Baro-VNAV systems, procedure NA below 2° C (36°F) or above 54°C (130°F). Circling NA north of Rwy 8L-26R. DME/DME RNP-0.3 NA.

MISSED APPROACH: Climb to 1500 then climbing right turn to 5000 direct IBAXE and hold, continue climb-in-hold to 5000.

D-ATIS 124.25	SOCAL APP CON 127.0 318.2	ONTARIO TOWER 120.6 360.775	GND CON 121.9 257.8	CLNC DEL 132.9	CPDLC
-------------------------	-------------------------------------	---------------------------------------	-------------------------------	--------------------------	-------

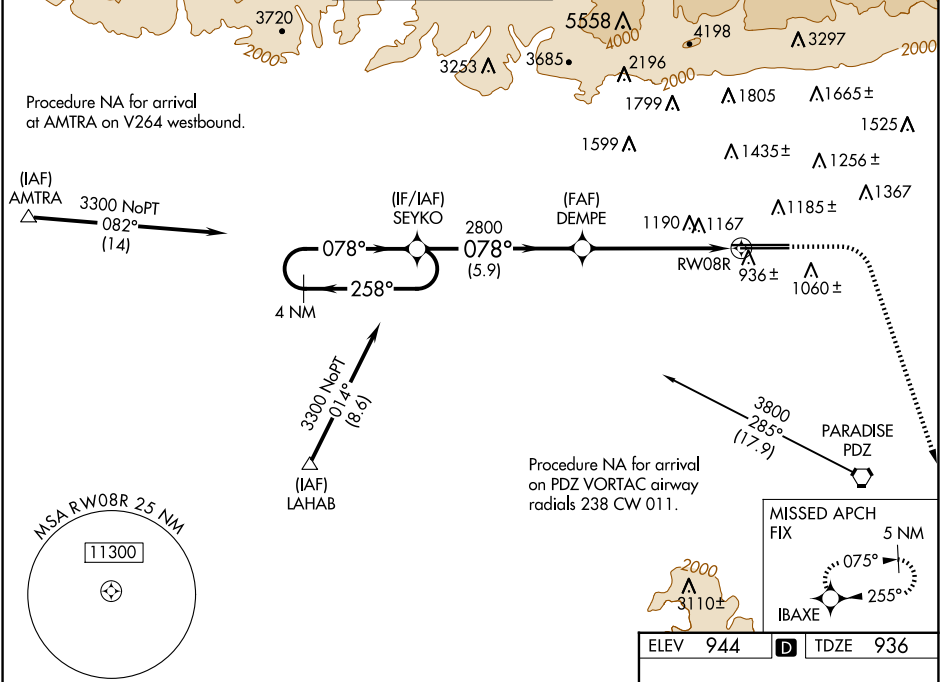

VGSI and RNAV glidepath not coincident (VGSI Angle 3.00/TCH 65)				
4 NM Holding Pattern	SEYKO	DEMPE	RW08R	IBAXE
3300	258°	2800	1.4 NM to RW08R	
GP 3.00°	078°	2800		
TCH 53				
	5.9 NM	4.3 NM	1.4 NM	
CATEGORY	A	B	C	D
LPV DA	1220/45	284 (300-7%)		
LNAV/VNAV DA	1494-1 7/8	558 (600-1%)		
LNAV MDA	1440/55	504 (500-1)	1440-1 3/8	504 (500-1%)
CIRCLING	1440-1	496 (500-1)	1540-1 1/2	1600-2
			596 (600-1 1/2)	656 (700-2)

