

LOC I-JAX

110.7

APP CRS

077°

Rwy ldg

10000

TDZE

30

Apt Elev

30

ILS Y RWY 8 (SA CAT I)

JACKSONVILLE INTL (JAX)

Requires specific OPSPEC, MSPEC, or LOA approval.

ALSF-2

MISSED APPROACH: Climb to 1000 then climbing left turn to 3000 on heading 250° and on CRG VORTAC R-290 to MONIA INT/CRG 29.2 DME/RADAR and hold.

D-ATIS

125.85

JACKSONVILLE APP CON

119.0 269.9

JACKSONVILLE TOWER

118.3 317.7


GND CON

121.9 348.6

CLNC DEL

119.5 290.275

CPDLC

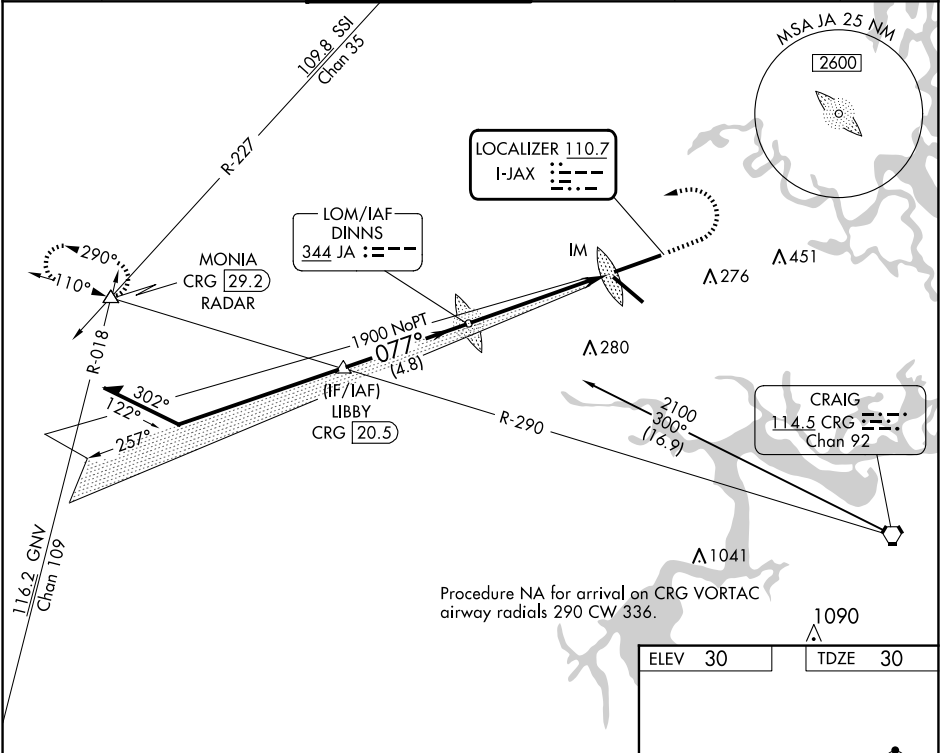

Remain within 15 NM

2000

257°

077°

GS 3.00° TCH 55

1861

1900

IM

5.6 NM

1046'

1000

3000

hdg 250°

CRG R-290

MONIA

△

VGSI and ILS glidepath not coincident (VGSI Angle 3.00°/TCH 70°).

CATEGORY

A

B

C

D

S-ILS 8

RA 175/14 150 DA 180

SA CATEGORY I - SPECIAL AIRCREW & AIRCRAFT CERTIFICATION REQUIRED

REIL Rwy 32

TDZ/CL Rwy 8, 14, and 26

HIRL Rwy 8-26 and 14-32