

APP CRS
257°

Rwy Idg
10000

TDZE
27

Apt Elev
30

RNAV (RNP) Y RWY 26

JACKSONVILLE INTL (JAX)


RNP AR APCH-GPS.

For uncompensated Baro-VNAV systems, procedure NA below -5°C or above 54°C.

MALSR

MISSED APPROACH: Climb to 2000 on track 257° to UDAQI and hold.

D-ATIS 125.85	JACKSONVILLE APP CON 119.0 269.9	JACKSONVILLE TOWER 118.3 317.7	GND CON 121.9 348.6	CLNC DEL 119.5 290.275	CPDLC
------------------	-------------------------------------	-----------------------------------	------------------------	---------------------------	-------

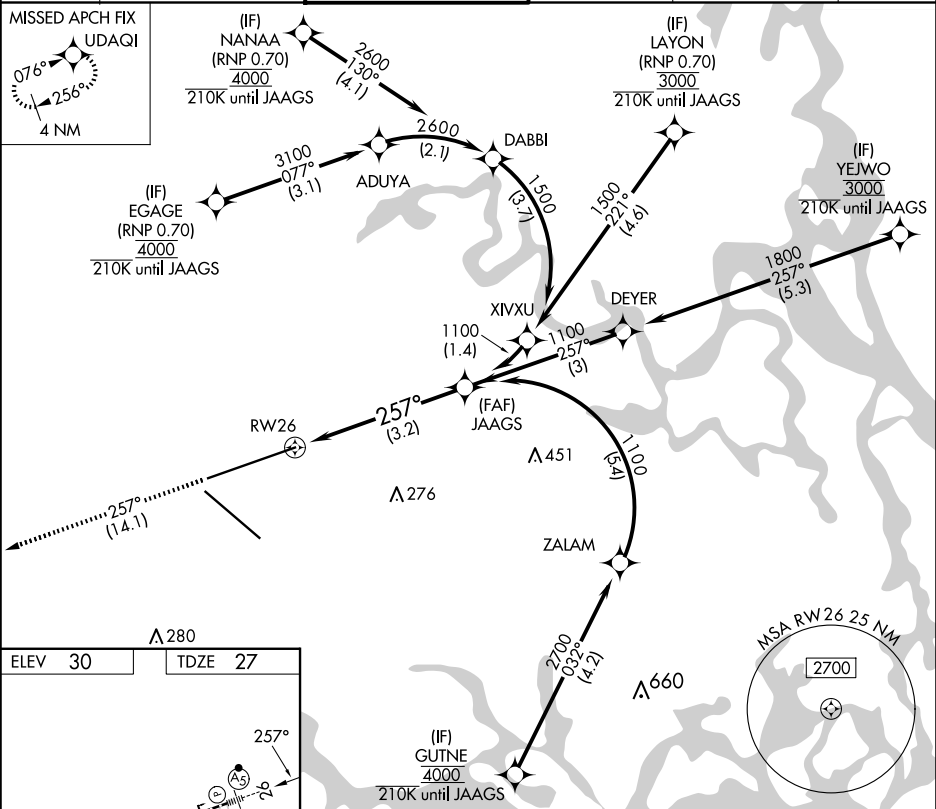

ELEV 30 TDZE 27

2000 UDAQI

VGSI and RNAV glidepath not coincident (VGSI Angle 3.00°/TCH 70°).

See planview for multiple IF locations.

CATEGORY	A	B	C	D
RNP 0.30 DA	419/35 392 (400-5%)			

AUTHORIZATION REQUIRED

SE-3, 17 APR 2025 to 15 MAY 2025

SE-3, 17 APR 2025 to 15 MAY 2025