
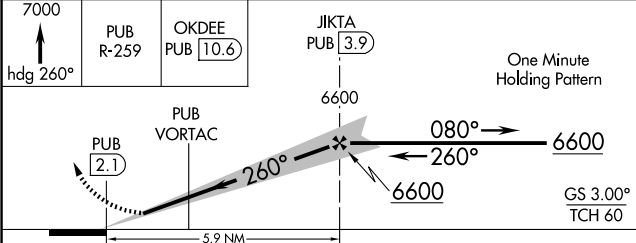


LOC I-FTR	APP CRS	Rwy Idg	10496
108.3	260°	TDZE	4659
		Apt Elev	4729

ILS or LOC RWY 26L

PUEBLO MEML (PUB)

DME required. RADAR required for procedure entry at PYNON.		MISSED APPROACH: Climb to 7000 on heading 260° and on PUB VORTAC R-259 to OKDEE/PUB 10.6 DME and hold.	
DME from PUB VORTAC, simultaneous reception of I-FTR and PUB DME required.			
ATIS	DENVER APP CON ★	PUEBLO TOWER ★	GND CON
125.25	120.1 290.5	119.1 (CTAF) 257.8	121.9
			CLNC DEL
			120.9
			UNICOM
			122.95

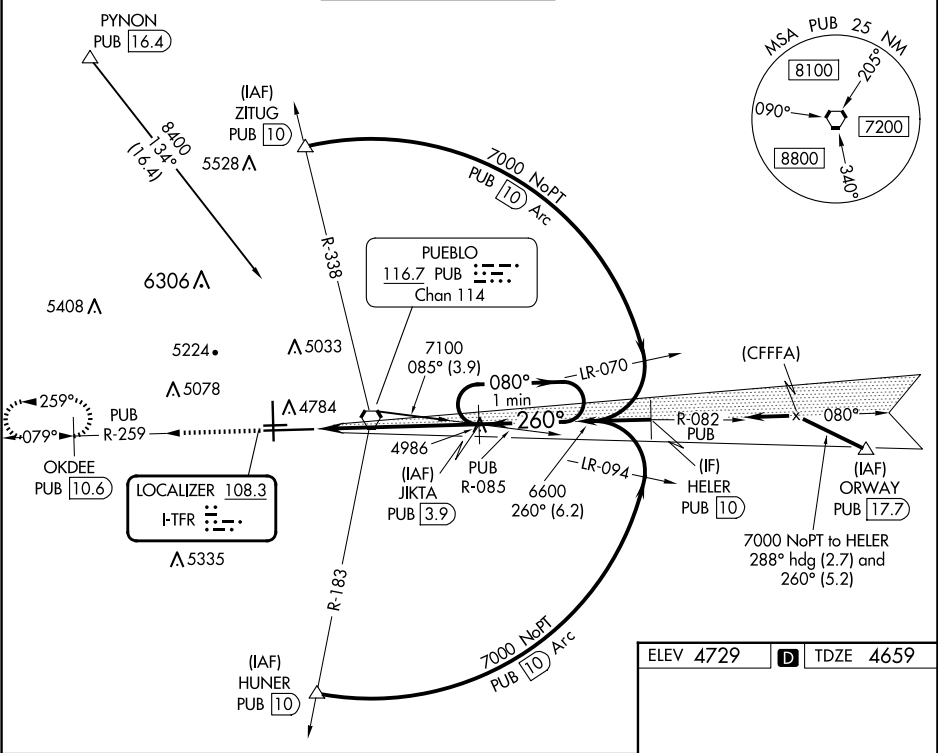

CATEGORY	A	B	C	D
S-ILS 26L	4859-¾ 200 (200-¾)			
S-LOC 26L	5160-1	501 (500-1)	5160-1¾	501 (500-1¾)
CIRCLING	5340-1	611 (700-1)	5580-2½ 851 (900-2½)	5800-3 1071 (1100-3)

