

WAAS
CH **65744**
W23A

APP CRS
233°

Rwy Idg **7543**
TDZE **710**
Apt Elev **716**

RNAV (GPS) RWY 23

WILLOW RUN (YIP)

RNP APCH - GPS.

▼


▲

For uncompensated Baro-VNAV systems, procedure NA below -19°C or above 54°C. For inop ALS, increase LNAV/VNAV all Cats visibility to ¾ SM, LNAV Cats C/D visibility to 1 SM.


MALSR

MISSED APPROACH:
Climb to 3000 direct
ZAVEX and hold,
continue climb-in-hold
to 3000.

ATIS 127.425	DETROIT APP CON 118.95 284.0	WILLOW RUN TOWER 125.275 256.9	GND CON 119.975
------------------------	--	--	---------------------------

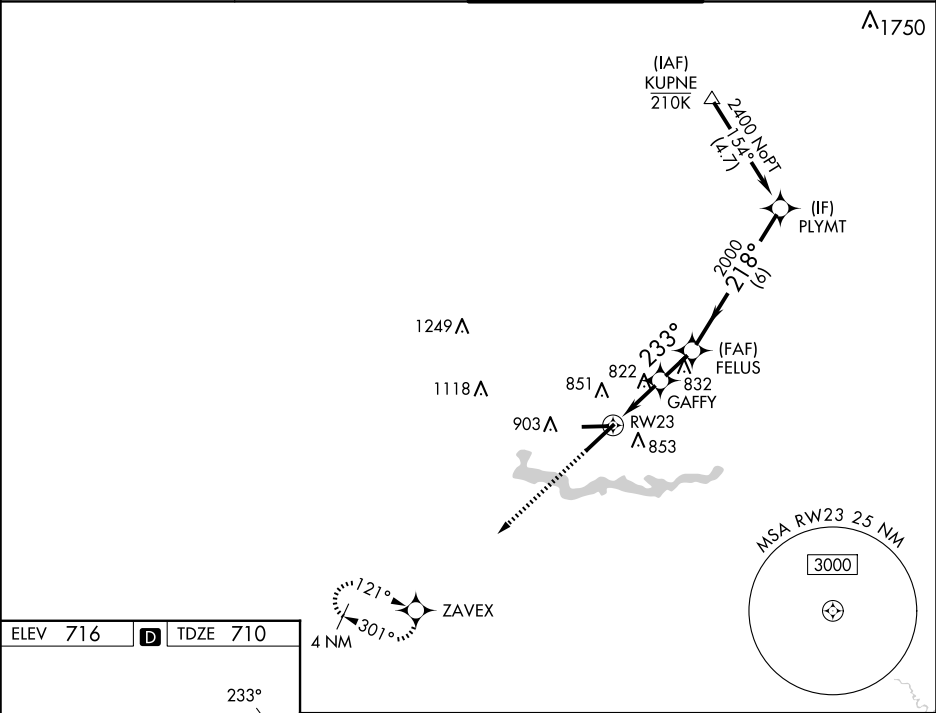

ELEV 716	D	TDZE 710
----------	----------	----------

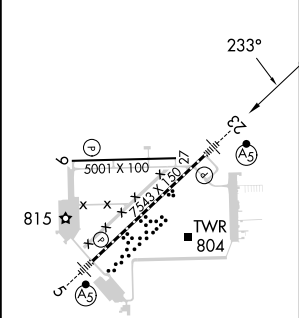

TDZ/CL Rwy 5
HIRL Rwy 5-23
MIRL Rwy 9-27

3000 ↑		ZAVEX ✦			
		GAFFY 2000		PLYMT 2400	
1 NM to RW23		FELUS 2000		218°	
RW23		233°		2000	
1 NM		1.3 NM		1.6 NM	
1 NM		6 NM		GP 3.00° TCH 57	
CATEGORY	A		B	C	D
LPV DA	910-½		200 (200-½)		
LNAV/ VNAV DA	982-½		272 (300-½)		
LNAV MDA	1080-½ 370 (400-½)		1080-⅝ 370 (400-⅝)		
C CIRCLING	1220-1 504 (600-1)		1220-1½ 504 (600-1½)		1400-2¼ 684 (700-2¼)