
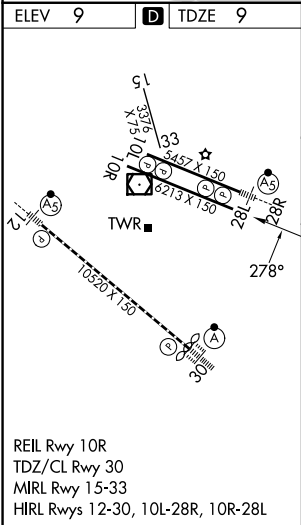


APP CRS	Rwy Ldg	6213
278°	TDZE	9
	Apt Elev	9

RNAV (RNP) Z RWY 28L
OAKLAND INTL (OAK)

RNP AR APCH - GPS. Authorization required.		MISSED APPROACH: Climb to 3000 on track 278° to OPLIE and on track 348° to REBAS and hold.		
▼ For uncompensated Baro-VNAV systems, procedure NA below 2°C or above 54°C.				
D-ATIS	NORCAL APP CON	OAKLAND TOWER	GND CON	CLNC DEL
133.775	125.35 263.15	118.3 291.65 (Rwys 10L/R-28L/R, 15-33) 127.2 256.9 (Rwy 12-30)	121.9 (Rwys 10L/R-28L/R, 15-33) 121.75 (Rwy 12-30)	121.1
				CPDLC

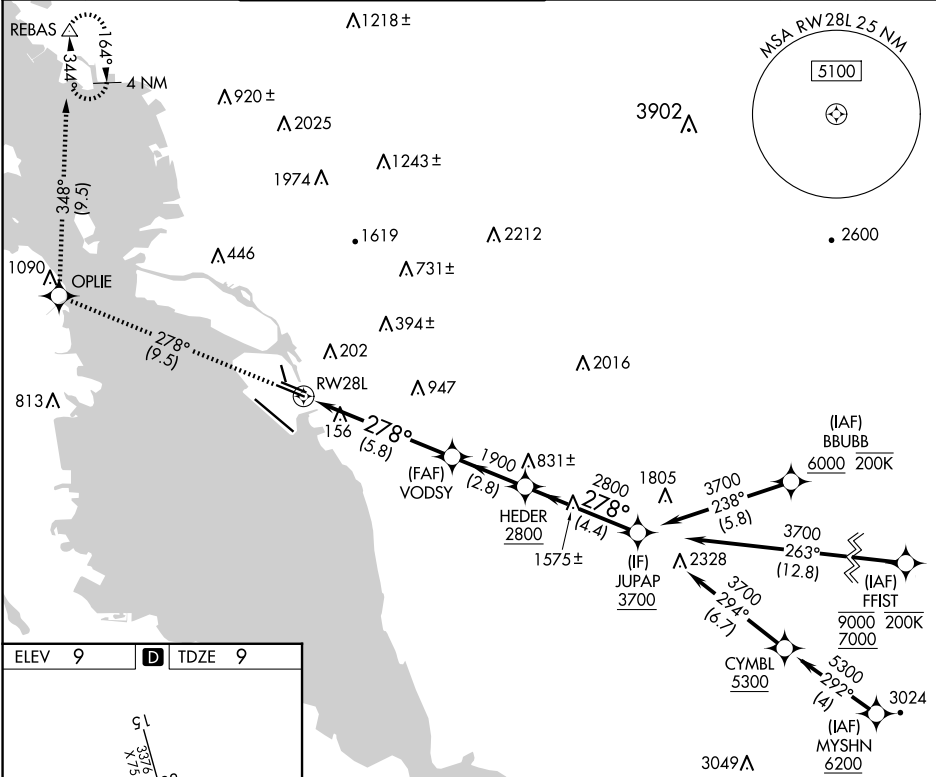

ELEV 9		D	TDZE 9
3000		OPLIE	REBAS
tr 278°		tr 348°	
VGS1 and RNAV glidepath not coincident (VGS1 Angle 3.00°/TCH 50).		JUPAP	
VODSY		HEDER	
RW28L		278°	3700
1900		2800	
1900			GP 3.00°
5.8 NM		2.8 NM	4.4 NM
CATEGORY	A	B	C
RNP 0.10 DA	306/45	297 (300-%)	
RNP 0.15 DA	359/55	350 (400-1)	
RNP 0.30 DA	425/60	416 (500-1¼)	
AUTHORIZATION REQUIRED			

SW-2, 12 JUN 2025 to 10 JUL 2025

SW-2, 12 JUN 2025 to 10 JUL 2025