


LOC/DME I-TLH 110.3 Chan 40	APP CRS 004°	Rwy Idg 7000 TDZE 62 Apt Elev 83	ILS Z or LOC Z RWY 36 TALLAHASSEE INTL (TLH)
---	------------------------	---	---

DME required. RADAR required for procedure entry at CVILL.			MALSR		MISSED APPROACH: Climb to 4000 direct SZW VORTAC and hold, continue climb-in-hold to 4000.	
ASR * RVR 1800 authorized with use of FD or AP or HUD to DA.						
ATIS		TALLAHASSEE APP CON *	TALLAHASSEE TOWER *	GND CON	CLNC DEL	UNICOM
119.45 239.25		135.8 317.4	118.7 (CTAF) 0 257.8	121.9 348.6	126.65 275.8	123.075

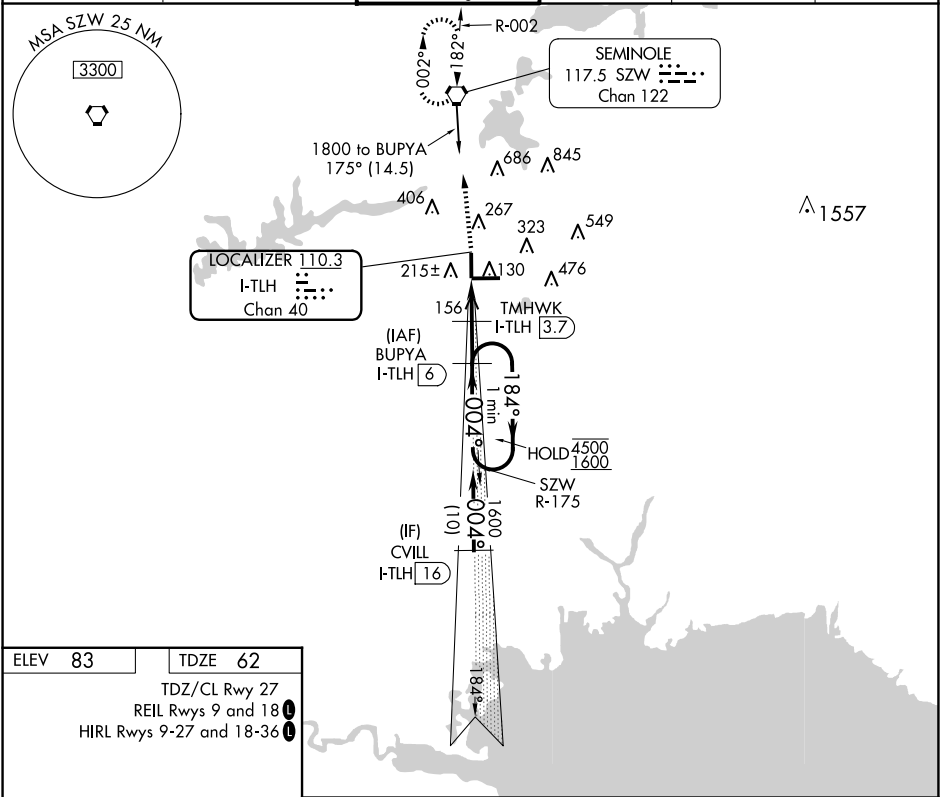

ELEV 83	TDZE 62	TDZ/CL Rwy 27 REIL Rwy 9 and 18 HIRL Rwy 9-27 and 18-36			
		One Minute Holding Pattern			
		BUPYA I-TLH 6			
		184° → 4500 ← 004° 1600			
		GS 3.00° TCH 54			
2.4 NM		2.3 NM			
CATEGORY	A	B	C	D	
S-ILS 36 *	262/24		200 (200-½)		
S-LOC 36	460/24	398 (400-½)	460/35	398 (400-¾)	
CIRCLING	580-1 497 (500-1)	600-1 517 (600-1)	640-1½ 557 (600-1½)	800-2¼ 717 (800-2¼)	