

APP CRS
176°

Rwy Idg
TDZE
Apt Elev

9802
1287
1296

RNAV (RNP) Z RWY 17L

OKC WILL ROGERS INTL (OKC)


ASR

For uncompensated Baro-VNAV systems, procedure NA below -12°C (11°F) or above 54°C (130°F). GPS required. Simultaneous approach authorized with Rwy 17R.
Use of FD or AP providing RNAV track guidance required during simultaneous operations.

MALSR

MISSED APPROACH:
Climb to 5000 on track 176° to JAVXE and hold, continue climb-in-hold to 5000.

D-ATIS 125.85	OKC CITY APP CON 124.6 266.8	ROGERS TOWER 119.35 269.45	GND CON 121.9 348.6	CLNC DEL 124.35
------------------	---------------------------------	-------------------------------	------------------------	--------------------

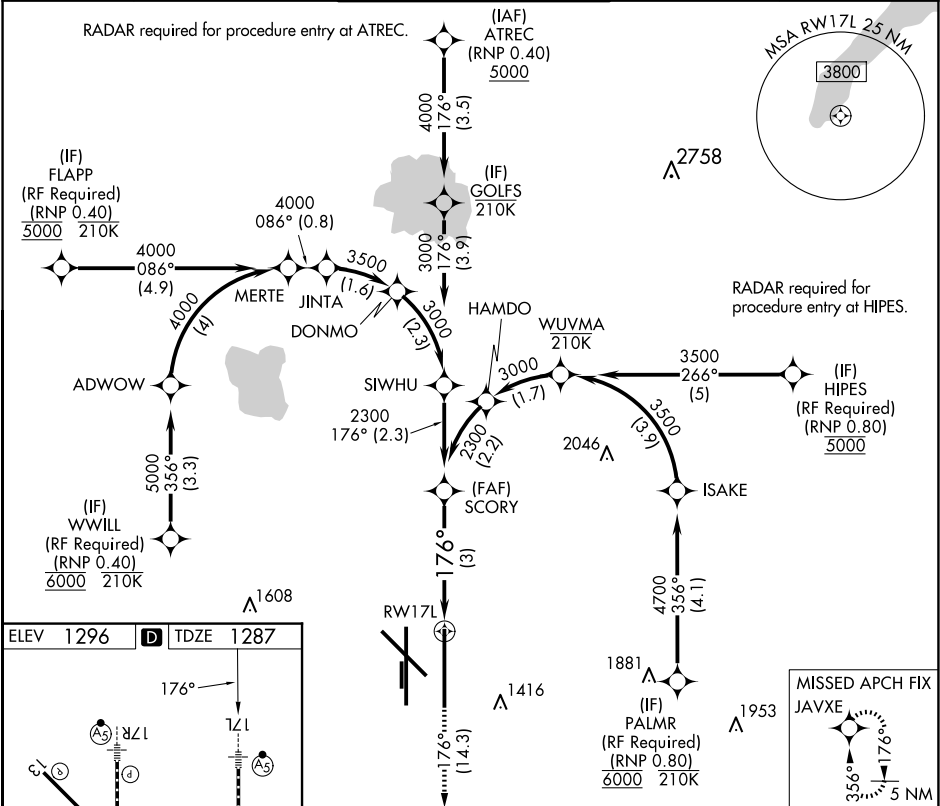

ELEV 1296

TDZE 1287

5000

↑

tr 176°

JAVXE

See planview for multiple IF locations.

SCORY

2300

2300

GP 3.00°

TCH 59

CATEGORY	A	B	C	D
RNP 0.11 DA		1555/24	268 (300-½)	
RNP 0.20 DA		1643/34	356 (400-¾)	
RNP 0.30 DA		1724/49	437 (500-1)	

AUTHORIZATION REQUIRED