

LOC/DME I-MHR 111.35 Chan 50(Y)	APP CRS 221°	Rwy Ldg TDZE Apt Elev	11301 98 98
---	------------------------	-----------------------------	--

ILS Z RWY 22L (SA CAT I & II)

SACRAMENTO MATHER (MHR)

⚠



Requires specific OPSPEC, MSPEC, or LOA approval.
Procedure NA when tower closed.

MALSR

MISSED APPROACH:

Climb to 1000, then climbing left turn to 3500 on heading 090° and SAC VORTAC R-058 to COSKA INT/SAC 24.2 DME and hold, continue climb-in-hold to 3500.

ATIS 118.325	NORCAL APP CON 127.4 317.5	MATHER TOWER ★ 120.65 (CTAF) 282.25	GND CON 121.85 307.9	CLNC DEL 121.85 307.9	UNICOM 122.95
------------------------	--------------------------------------	---	--------------------------------	---------------------------------	-------------------------

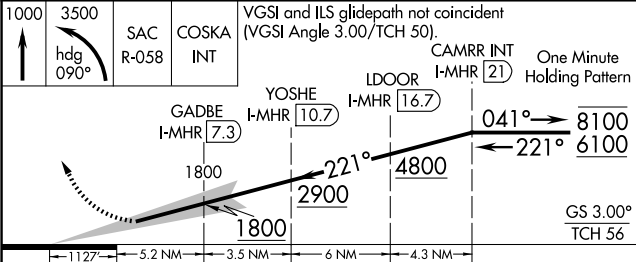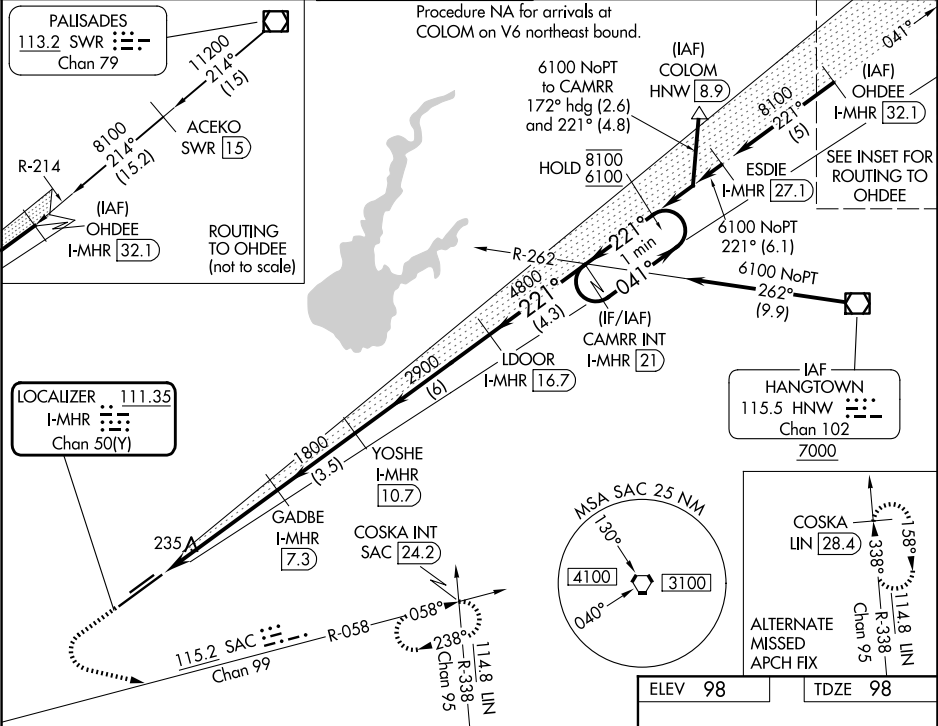

CATEGORY	A	B	C	D
S-ILS 22L	SA CAT I	RA 136/14 150	DA 248	
S-ILS 22L	SA CAT II	RA 95/12 100	DA 198	

SA CATEGORY I & II ILS - SPECIAL AIRCREW & AIRCRAFT CERTIFICATION REQUIRED

