

|         |          |      |
|---------|----------|------|
| APP CRS | Rwy Idg  | 5700 |
| 196°    | TDZE     | 54   |
|         | Apt Elev | 56   |

RNAV (RNP) Z RWY 20R  
JOHN WAYNE/ORANGE COUNTY (SNA)


RNP AR APCH - GPS. Authorization required. From JWARD: min RNP 0.50. From KLEVR, RF, min RNP 0.70.

For uncompensated Baro-VNAV systems, procedure NA below 5°C or above 54°C.


MALSR

MISSED APPROACH: Climb to 3000 on track 196° to MINOE and hold, continue climb-in-hold.

|                 |                              |                                            |                  |                   |       |                  |
|-----------------|------------------------------|--------------------------------------------|------------------|-------------------|-------|------------------|
| D-ATIS<br>126.0 | SOCAL APP CON<br>121.3 263.1 | JOHN WAYNE TOWER ★<br>126.8 (CTAF) 343.625 | GND CON<br>120.8 | CLNC DEL<br>118.0 | CPDLC | UNICOM<br>122.95 |
|-----------------|------------------------------|--------------------------------------------|------------------|-------------------|-------|------------------|

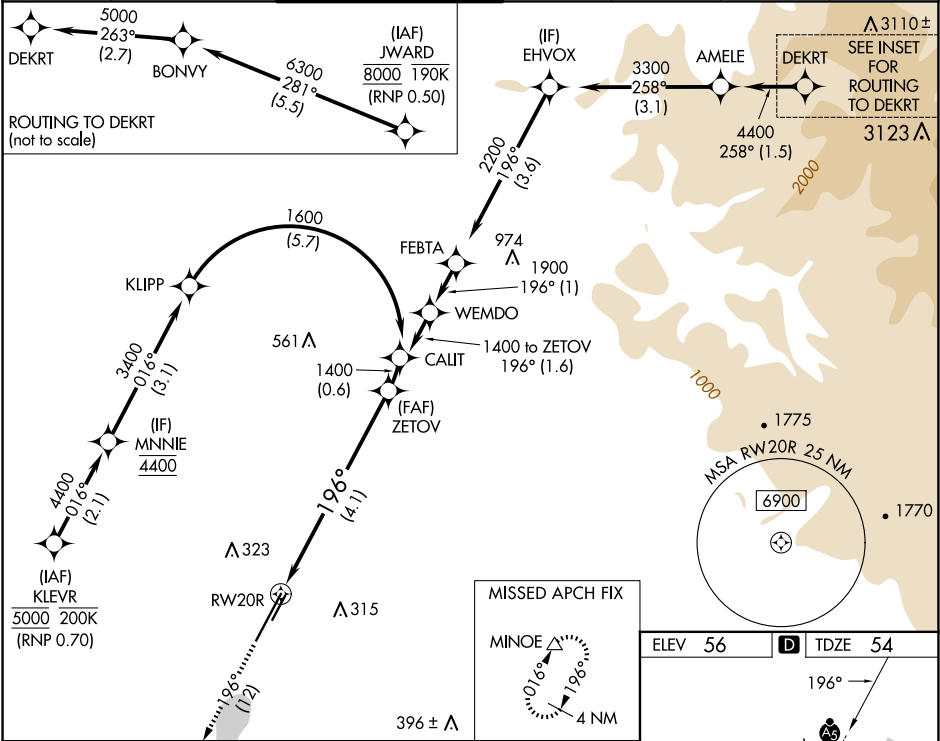

|                        |         |                                                                                                          |              |                 |  |
|------------------------|---------|----------------------------------------------------------------------------------------------------------|--------------|-----------------|--|
| 3000 tr 196°           | MINOE Δ | VGSI and RNAV glidepath not coincident (VGSI Angle 3.00/TCH 68). See planview for multiple IF locations. |              |                 |  |
| RW20R                  |         | ZETOV 1400                                                                                               |              | GP 3.00° TCH 51 |  |
|                        |         | 4.1 NM                                                                                                   |              |                 |  |
| CATEGORY               | A       | B                                                                                                        | C            | D               |  |
| RNP 0.11 DA            |         | 376/26                                                                                                   | 322 (400-½)  |                 |  |
| RNP 0.15 DA            |         | 562/55                                                                                                   | 508 (600-1)  |                 |  |
| RNP 0.30 DA            |         | 618-1¼                                                                                                   | 564 (600-1¼) |                 |  |
| AUTHORIZATION REQUIRED |         |                                                                                                          |              |                 |  |

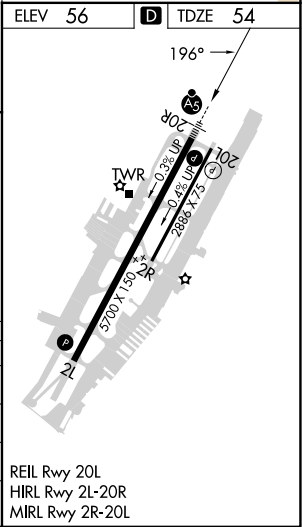

SW-3, 04 SEP 2025 to 02 OCT 2025

SW-3, 04 SEP 2025 to 02 OCT 2025