


APP CRS	Rwy Ldg	6857
130°	TDZE	451
	Apt Elev	477

RNAV (RNP) Z RWY 13R

PALM SPRINGS INTL (PSP)

RNP AR APCH-GPS, RF, min RNP 0.50. Authorization required.			MISSED APPROACH: Climb to 900 then climbing left turn to 4000 direct TRM VORTAC and hold.		
▼ For uncompensated Baro-VNAV systems, procedure NA below 4°C or above 54°C.					
ATIS 124.65	SOCAL APP CON 126.7 370.95 135.275 251.1	PALM SPRINGS TOWER★ 119.7 (CTAF) 377.05	GND CON 121.9	CLNC DEL 128.35	UNICOM 122.95

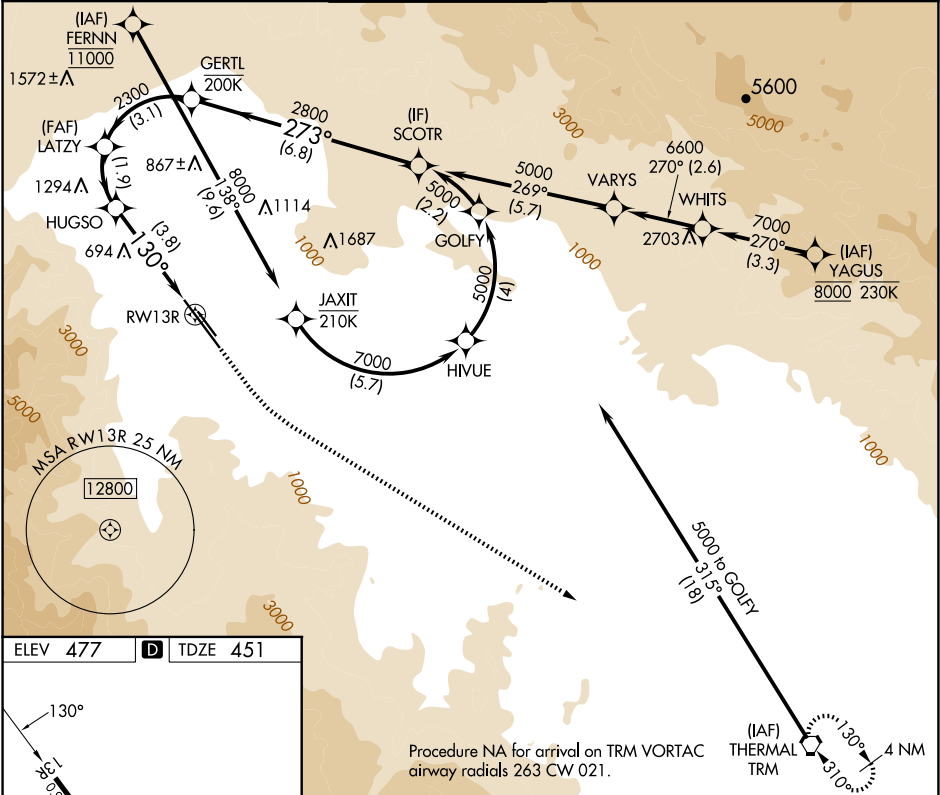

ELEV 477

TDZE 451

130°

50 0.2% DOWN

0

TEI

4653 X 7.5

10000 X 130

TWR

31L

HIRL Rwy 13R-31L

MIRL Rwy 13L-31R

REIL Rwy 13R and 31L

REIL Rwy 13L and 31R

SCOTR		GERTL		LATZY		HUGSO		RW13R	
5000		2800		2300		1711		310	
GP 3.00° TCH 50									
6.8 NM		3.1 NM		1.9 NM		3.8 NM			
CATEGORY		A		B		C		D	
RNP 0.10 DA		749-7/8		298 (300-7/8)					
RNP 0.30 DA		882-1¼		431 (500-1¼)					
AUTHORIZATION REQUIRED									