

APP CRS
164°

Rwy Ldg
TDZE
163

Apt Elev
171

RNAV (RNP) Z RWY 16

BELLINGHAM INTL (BLI)


RNP AR APCH

For uncompensated Baro-VNAV systems, procedure NA below -10°C or above 54°C. For inop ALS, increase RNP 0.27 all Cats visibility to RVR 4500, increase RNP 0.30 all Cats visibility to RVR 6000.

MALSR

MISSED APPROACH: Climb to 700 then climbing right turn to 2000 direct TECUV and hold.

ATIS 134.45	VICTORIA TERMINAL APP CON 132.7	BELLINGHAM TOWER★ 124.9 (CTAF) 0 379.3	GND CON 127.4 379.3	UNICOM 122.95
-----------------------	---	--	-------------------------------	-------------------------

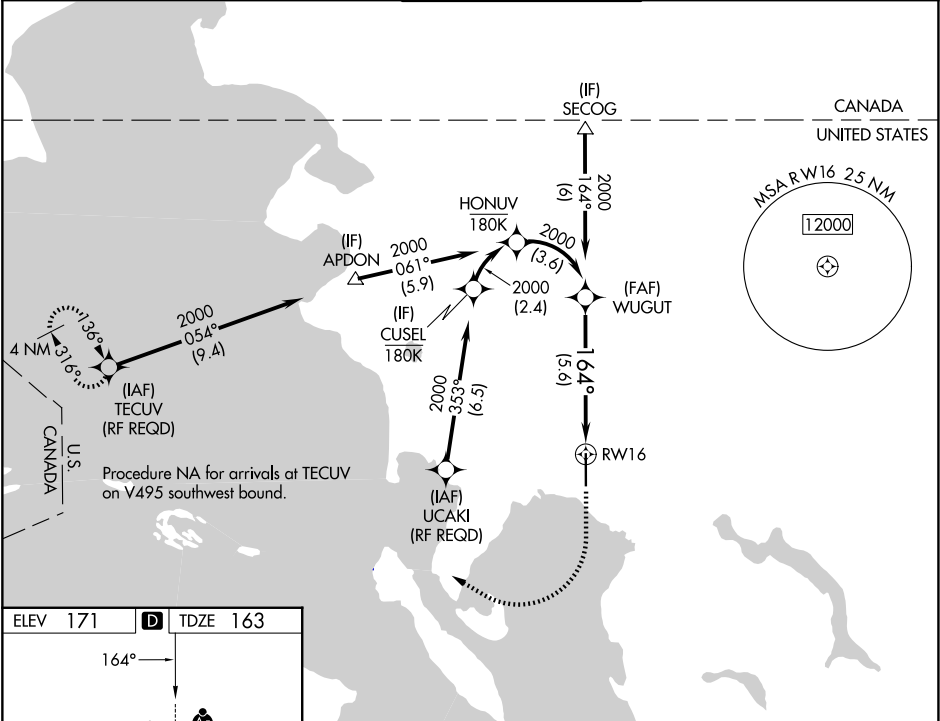

ELEV 171 **D** TDZE 163

164°

91

6700 X 000/27

34

TWR

WUGUT

2000

2000

164°

GP 3.00° TCH 51

See planview for multiple IF locations.

5.6 NM

RW16

700

2000

TECUV

CATEGORY	A	B	C	D
RNP 0.27 DA	483/24	320 (400-½)		
RNP 0.30 DA	580/45	417 (500-¾)		

AUTHORIZATION REQUIRED