

APP CRS
031°

Rwy Ldg
TDZE
Apt Elev
7000
35
46

RNAV (RNP) Z RWY 3
CHARLESTON AFB/INTL (CHS)


RNP AR APCH.

▼

For uncompensated Baro-VNAV systems, procedure NA below -5°C or above 54°C.

MISSED APPROACH: Climb to 3000 direct BAMDE and hold, continue to climb-in-hold to 3000.

D-ATIS 124.75	CHARLESTON APP CON 120.7 306.925	CHARLESTON TOWER 126.0 239.0	GND CON 121.9 348.6	CLNC DEL 127.325 291.65	CPDLC
-------------------------	--	--	-------------------------------	-----------------------------------	-------

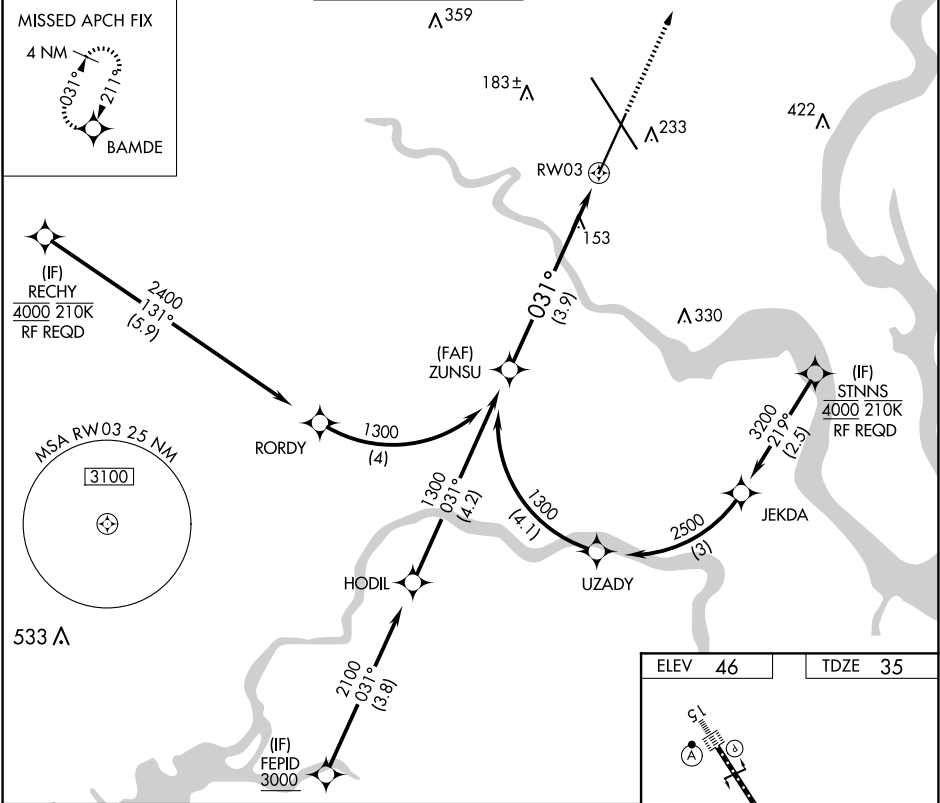

See planview for multiple IF locations.

3000 BAMDE

GP 3.00°
TCH 50

3.9 NM

CATEGORY	A	B	C	D
RNP 0.20 DA	285-3/4 250 (300-3/4)			
RNP 0.30 DA	429-11/8 394 (400-11/8)			

AUTHORIZATION REQUIRED

ELEV 46

TDZE 35

TDZ/CL Rwy 15

REIL Rwys 3 and 21

HIRL Rwys 3-21 and 15-33