

APP CRS
099°

Rwy Ldg
TDZE **16**
Apt Elev **20**

RNAV (RNP) Z RWY 10L
PALM BEACH INTL (PBI)


RNP AR APCH - GPS.

For uncompensated Baro-VNAV systems, procedure NA below 6°C or above 54°C.

MALSR

MISSED APPROACH: Climb to 1000 then climbing left turn to 3000 direct MORGA and hold.

D-ATIS 123.75	PALM BEACH APP CON 128.3 317.4	PALM BEACH TOWER 119.1 257.8	GND CON 121.9 284.6	CLNC DEL 121.6 284.6	CPDLC
-------------------------	--	--	-------------------------------	--------------------------------	-------

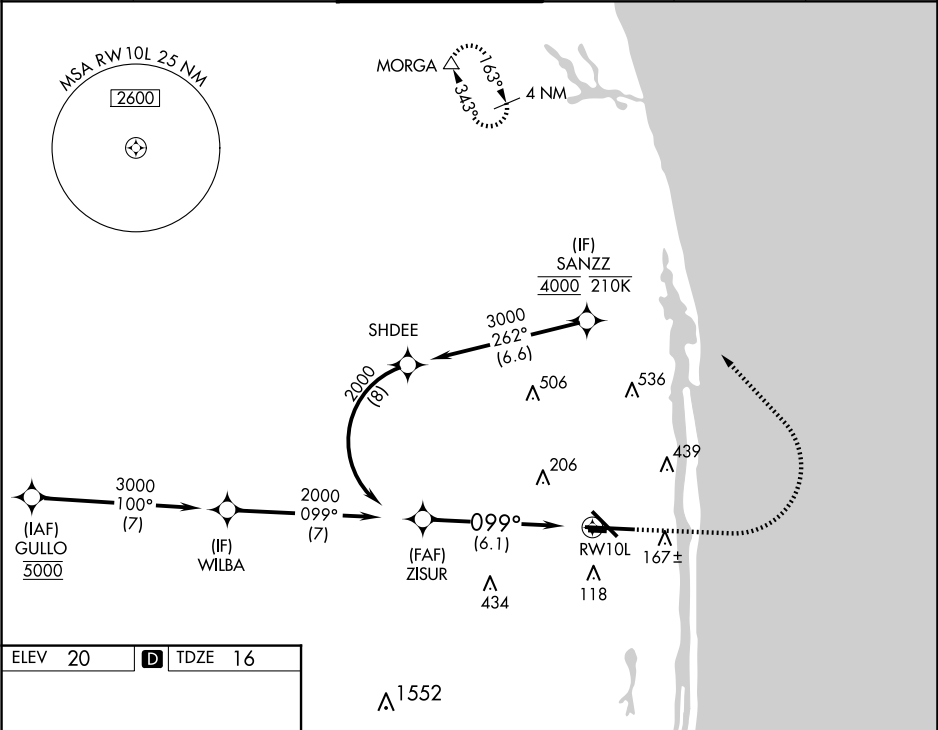

ELEV 20

D

TDZE 16

HIRL Rwy 10L-28R
REIL Rws 10R, 14, 28L, 28R and 32
MIRL Rws 14-32 and 10R-28L

VGSI and RNAV glidepath not coincident (VGSI Angle 3.00/TCH 68).

1000

3000

MORGA

ZISUR

2000

2000

099°

RWY10L

GP 3.00°
TCH 52

See planview for multiple IF locations.

6.1 NM

CATEGORY	A	B	C	D
RNP 0.30 DA	355/26 339 (400-½)			

AUTHORIZATION REQUIRED

SE-3, 02 OCT 2025 to 30 OCT 2025

SE-3, 02 OCT 2025 to 30 OCT 2025