


APP CRS	Rwy Ldg	6857
130°	TDZE	451
	Apt Elev	477

RNAV (RNP) Z RWY 13R

PALM SPRINGS INTL (PSP)

RNP AR APCH-GPS, RF, min RNP 0.50. Authorization required.			MISSED APPROACH: Climb to 900 then climbing left turn to 4000 direct TRM VORTAC and hold.		
▼ For uncompensated Baro-VNAV systems, procedure NA below 4°C or above 54°C.					
ATIS 124.65	SOCAL APP CON 126.7 370.95 135.275 251.1	PALM SPRINGS TOWER★ 119.7 (CTAF) 377.05	GND CON 121.9	CLNC DEL 128.35	UNICOM 122.95

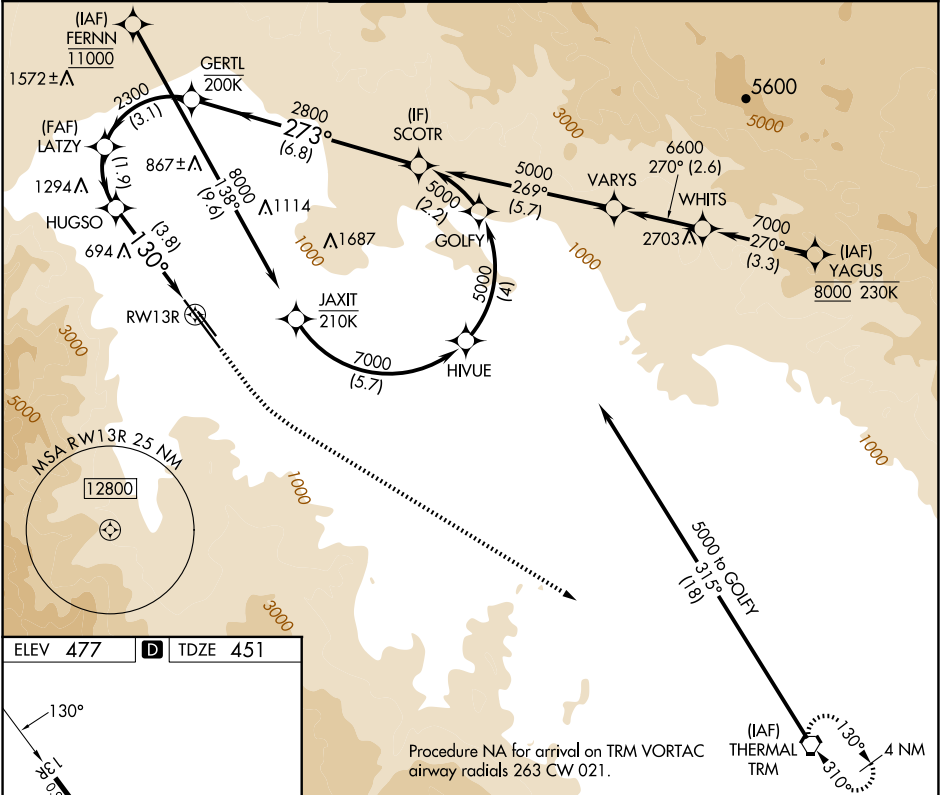

ELEV 477

D

TDZE 451

130°

50 0.2% DOWN

0

TEI

4653 X 7.5

10000 X 130

TWR

31L

0.2% UP R

0.7% UP D

HIRL Rwy 13R-31L

MIRL Rwy 13L-31R

REIL Rwy 13R and 31L

REIL Rwy 13L and 31R

SCOTR		GERTL		LATZY		HUGSO		RWY13R										
5000		2800		2300		1711		310										
GP 3.00° TCH 50																		
6.8 NM		3.1 NM		1.9 NM		3.8 NM												
CATEGORY	A	B	C	D														
RNP 0.10 DA	749-7/8 298 (300-7/8)																	
RNP 0.30 DA	882-1 1/4 431 (500-1 1/4)																	
AUTHORIZATION REQUIRED																		

SW-3, 02 OCT 2025 to 30 OCT 2025

SW-3, 02 OCT 2025 to 30 OCT 2025