
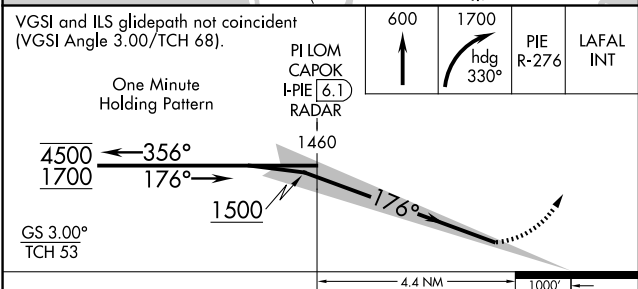


|                                                 |                        |                                                            |
|-------------------------------------------------|------------------------|------------------------------------------------------------|
| LOC/DME I-PIE<br><b>109.1</b><br>Chan <b>28</b> | APP CRS<br><b>176°</b> | Rwy Ldg <b>9180</b><br>TDZE <b>7</b><br>Apt Elev <b>11</b> |
|-------------------------------------------------|------------------------|------------------------------------------------------------|

ILS RWY 18 (SA CAT I & II)  
ST PETE-CLEARWATER INTL (PIE)

|                                                                                                                          |                                                                                            |                                                                                                                                                                      |
|--------------------------------------------------------------------------------------------------------------------------|--------------------------------------------------------------------------------------------|----------------------------------------------------------------------------------------------------------------------------------------------------------------------|
| DME, RADAR, or ADF required.                                                                                             | MALSR<br> | MISSED APPROACH: Climb to 600 then climbing right turn to 1700 on heading 330° and PIE VORTAC R-276 to LAFAL INT/PIE 8 DME and hold, continue climb-in-hold to 1700. |
| SA CAT I & II: Requires specific OPSPEC, MSPEC, or LOA approval.<br>SA CAT I & II S-ILS 18 NA when control tower closed. |                                                                                            |                                                                                                                                                                      |

|                      |                                      |                                                                 |                               |                                |                         |
|----------------------|--------------------------------------|-----------------------------------------------------------------|-------------------------------|--------------------------------|-------------------------|
| ATIS<br><b>134.5</b> | TAMPA APP CON<br><b>125.3 316.05</b> | ST PETERSBURG-CLEARWATER TOWER ★<br><b>118.3 (CTAF) 0 257.8</b> | GND CON<br><b>121.9 348.6</b> | CLNC DEL<br><b>120.6 350.2</b> | UNICOM<br><b>122.95</b> |
|----------------------|--------------------------------------|-----------------------------------------------------------------|-------------------------------|--------------------------------|-------------------------|

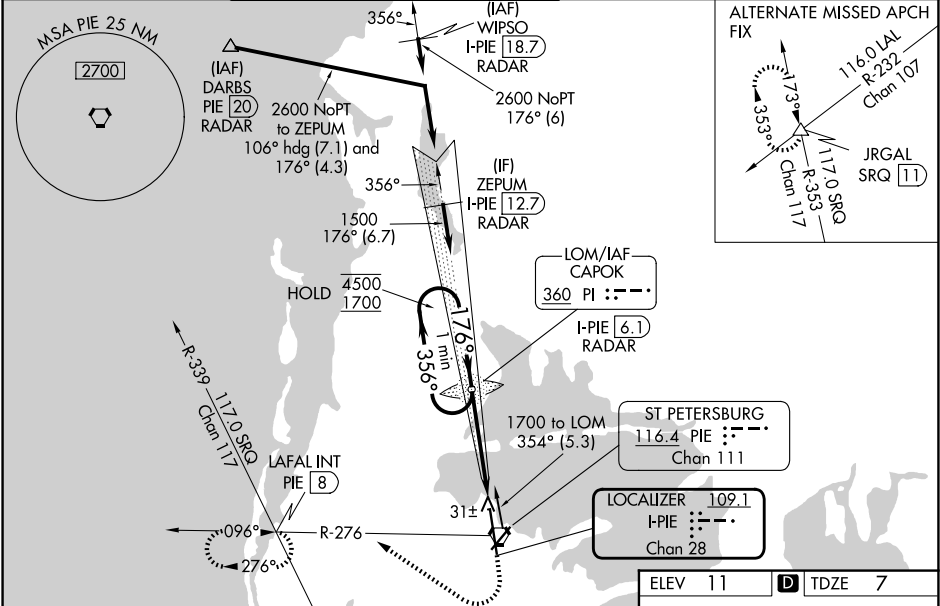

| CATEGORY | A         | B         | C   | D      |
|----------|-----------|-----------|-----|--------|
| S-ILS 18 | SA CAT I  | RA 157/14 | 150 | DA 157 |
| S-ILS 18 | SA CAT II | RA 107/12 | 100 | DA 107 |

**SA CATEGORY I & II ILS - SPECIAL AIRCREW & AIRCRAFT CERTIFICATION REQUIRED**

