
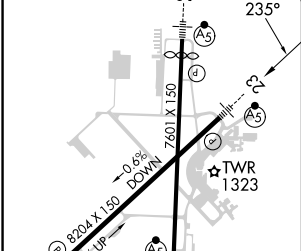


WAAS CH 90220 W23A	APP CRS 235°	Rwy Idg TDZE 1226 Apt Elev 1226
--	------------------------	---

RNAV (GPS) RWY 23
AKRON-CANTON RGNL(CAK)

⚠ For uncompensated Baro-VNAV systems, LNAV/VNAV NA below -17°C (2°F) or above 46°C (114°F). DME/DME RNP-0.3 NA. For inoperative MALSR, increase LNAV Cat D visibility to RVR 6000. ** RVR 1800 authorized with use of FD or AP or HUD to DA.	MALSR 	MISSED APPROACH: Climb to 3000 direct CICEE and on track 147° to BSV VOR/DME and hold.
---	---	--

ATIS 121.05	CLEVELAND APP CON* 125.5 269.25	AKRON-CANTON TOWER 134.75 279.575	GND CON 121.7 348.6	CLNC DEL 132.05
-----------------------	---	---	-------------------------------	---------------------------

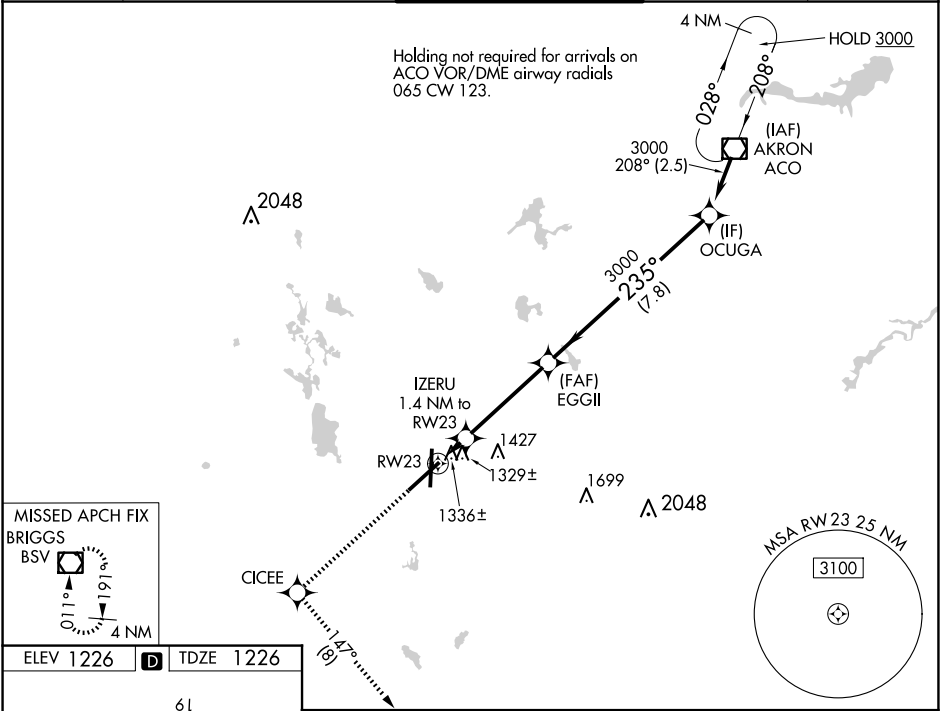

3000 ↑ CICEE tr 147° BSV				Procedure Turn NA	
* LNAV only EGGII 3000 OCUGA 3000 GP 3.00° TCH 45 3000 235° 3000 1700 1.4 NM to RW23 1.4 4 NM 7.8 NM					
CATEGORY	A		B	C	D
LPV DA**	1426/24 200 (200-½)				
LNAV/ VNAV	1691/60 465 (500-1¼)				
LNAV MDA	1640/24	414 (500-½)	1640/40 414 (500-¾)	1640/50 414 (500-1)	
CIRCLING	1760-1	534 (600-1)	1780-1½ 554 (600-½)	1800-2 574 (600-2)	