



APP CRS	Rwy Ldg	7597
306°	TDZE	55
	Apt Elev	62

RNAV (RNP) Z RWY 30R

NORMAN Y MINETA SAN JOSE INTL (SJC)

RNP AR APCH.	MISSED APPROACH: Climb to 600 then climb to 2000 direct ARTAQ and hold.
▼ For uncompensated Baro-VNAV systems, procedure NA below 1°C or above 54°C.	

D-ATIS 126.95	NORCAL APP CON 120.1 290.25	SAN JOSE TOWER ★ 124.0 (CTAF) 257.6	GND CON 121.7	UNICOM 122.95
------------------	--------------------------------	--	------------------	------------------

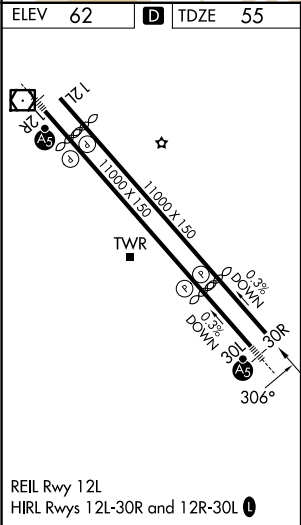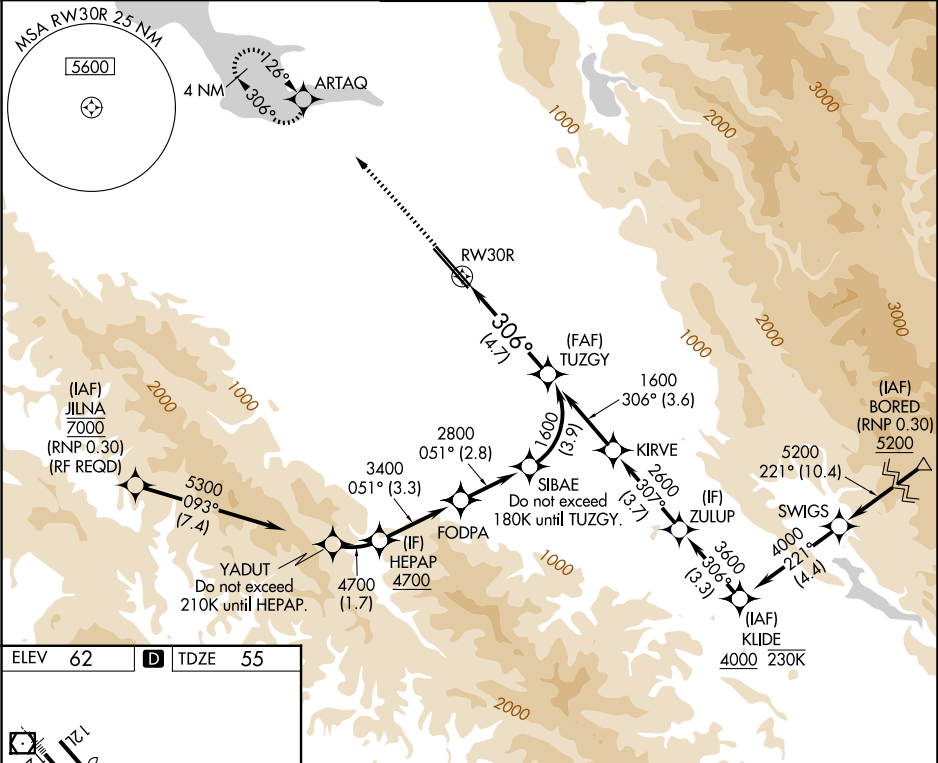

600 ↑	2000 ↑	ARTAQ 	VGSI and RNAV glidepath not coincident (VGSI Angle 3.00/TCH 69).	TUZGY 1600
See planview for multiple IF locations.				
CATEGORY	A	B	C	D
RNP 0.11 DA	377-1 322 (400-1)			
RNP 0.20 DA	472-1 $\frac{1}{8}$ 417 (500-1 $\frac{1}{8}$)			
RNP 0.30 DA	538-1 $\frac{3}{8}$ 483 (500-1 $\frac{3}{8}$)			
AUTHORIZATION REQUIRED				