WAAS CH 90415 W09A	APP CRS 095°	Rwy Ldg 6520 TDZE 981 Apt Elev 981

RNAV (GPS) RWY 9R
OAKLAND COUNTY INTL (PTK)

RNP APCH.

For uncompensated Baro-VNAV systems, LNAV/VNAV NA below -16°C (4°F) or above 47°C (116°F). Baro-VNAV and VDP NA when using Coleman A Young altimeter setting. Circling Rwy 9L, 36 NA at night. When local altimeter setting not received, use Coleman A Young Muni altimeter setting and increase LPV DA to 1286 feet, LNAV/VNAV DA to 1685 feet and all MDA 120 feet, increase LNAV/VNAV all Cats visibility to 2 SM, increase LNAV Cat C visibility to RVR 5000, Cat D visibility to RVR 6000, and Circling Cat C/D visibility ½ SM. For inop MALSR increase LNAV Cats A/B visibility to RVR 5000. For inop MALSR when using Coleman A Young Muni altimeter setting; increase LPV all Cats, and LNAV Cats A/B visibility to RVR 5000. # RVR 1800 authorized with use of FD or AP or HUD to DA, NA when using Coleman A Young Muni alitmeter setting.

MALSR

MISSED APPROACH: Climb to 3000 direct GUZVY and hold.

ATIS	DETROIT APP CON	PONTIAC TOWER ★	GND CON	UNICOM
125.025	132.35 284.0	120.5 (CTAF) L	121.9	122.95

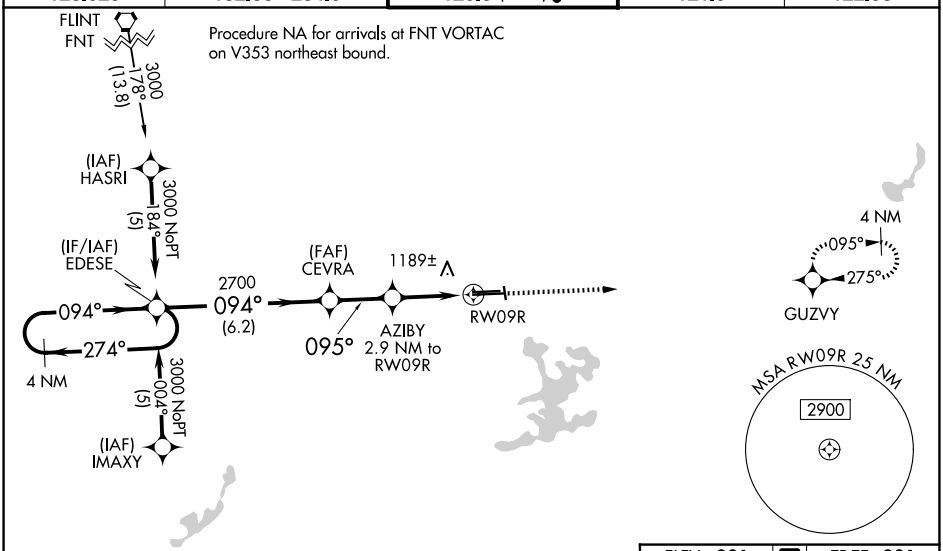

ELEV 981	D	TDZE 981

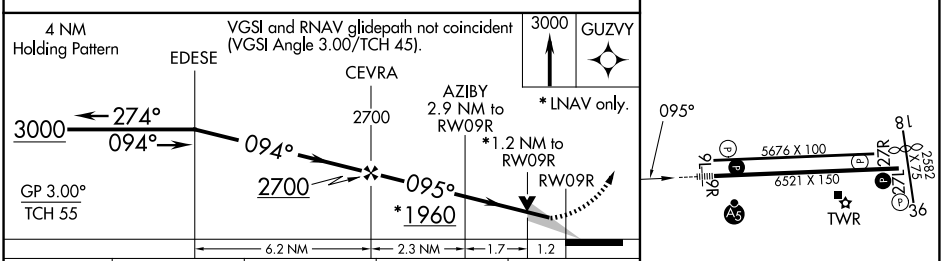

CATEGORY	A	B	C	D
LPV DA	1181/24 200 (200-½)			
LNAV/VNAV DA	1580-1½ 599 (600-1½)			
LNAV MDA	1420/40 439 (500-¾)			1420/50 439 (500-1)
CIRCLING	1500-1 519 (600-1)	1540-1 559 (600-1)	1640-1¾ 659 (700-1¾)	1640-2 659 (700-2)

HIRL Rwy 9R-27L L
MIRL Rwy 9L-27R
REIL Rwy 27L L
REIL Rwys 9L and 27R

EC-1, 02 OCT 2025 to 30 OCT 2025