

WAAS
CH **65744**
W23A

APP CRS
233°

Rwy Ldg **7543**
TDZE **710**
Apt Elev **716**

RNAV (GPS) RWY 23

WILLOW RUN (YIP)

RNP APCH - GPS.

▼


▲

For uncompensated Baro-VNAV systems, procedure NA below -19°C or above 54°C. For inop ALS, increase LNAV/VNAV all Cats visibility to ¾ SM, LNAV Cats C/D visibility to 1 SM.

MALSR

MISSED APPROACH:
Climb to 3000 direct
ZAVEX and hold,
continue climb-in-hold to 3000.

ATIS 127.425	DETROIT APP CON 118.95 284.0	WILLOW RUN TOWER 125.275 256.9	GND CON 119.975
------------------------	--	--	---------------------------

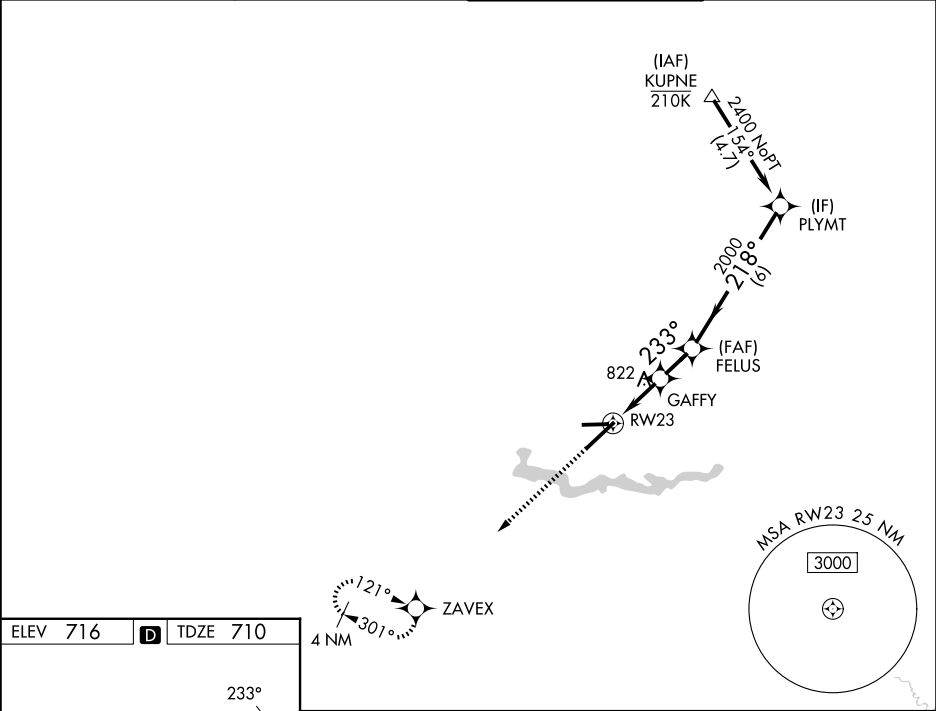

ELEV 716

D

TDZE 710

3000

ZAVEX

GAFFY

FELUS

PLYMT

1 NM to RW23

1 NM

1.3 NM

1.6 NM

6 NM

233°

218°

2400

1500

2000

GP 3.00°

TCH 57

CATEGORY	A	B	C	D
LPV DA		910-½	200 (200-½)	
LNAV/VNAV DA		982-½	272 (300-½)	
LNAV MDA	1080-½	370 (400-½)	1080-⅝	370 (400-⅝)
CIRCLING	1220-1	504 (600-1)	1220-1½ 504 (600-1½)	1400-2¼ 684 (700-2¼)

TDZ/CL Rwy 5

HIRL Rwy 5-23

MIRL Rwy 9-27

EC-1, 30 OCT 2025 to 27 NOV 2025

EC-1, 30 OCT 2025 to 27 NOV 2025