

APP CRS	Rwy Ldg	7510
312°	TDZE	43
	Apt Elev	46


RNAV (RNP) Z RWY 31
CORPUS CHRISTI INTL (CRP)

⚠ For uncompensated Baro-VNAV systems, procedure NA below -1°C (31°F) or above 54°C (130°F). GPS and RF required. For inop MALSR, increase RNP 0.14 all Cats visibility to ¾ mile.
* Missed approach requires minimum climb of 335 feet per NM to 500.

MALSR

MISSED APPROACH: Climb to 2000 on track 312° to ATHIS and hold.

ATIS 126.8	CORPUS APP CON 120.9 348.725	CORPUS TOWER 119.4 257.8	GND CON 121.9 269.15	CLNC DEL 118.55
---------------	---------------------------------	-----------------------------	-------------------------	--------------------

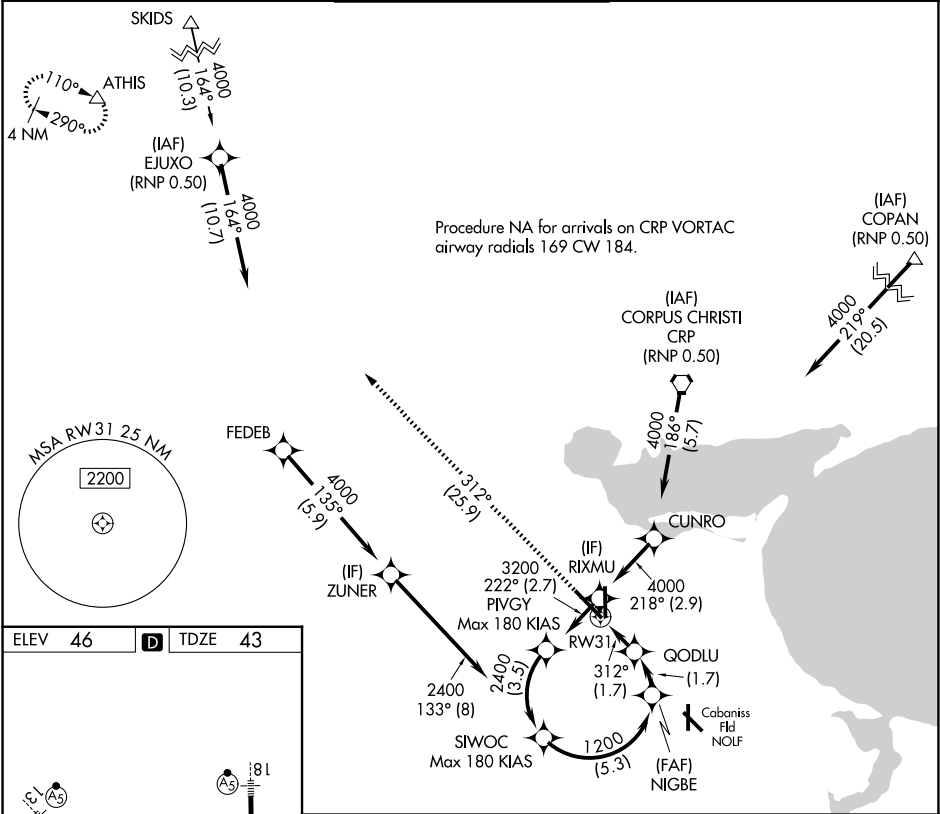

ELEV 46

D

TDZE 43

HIRL Rwy 13-31 and 18-36

2000	ATHIS	See planview for multiple IF locations.		SIWOC
↑	fr 312°	GODLU	NIGBE	2400
		646	1200	
				GP 3.00°
				TCH 50
		1.7 NM	1.7 NM	5.3 NM
CATEGORY	A	B	C	D
RNP 0.14 DA*		303-1/2	260 (300-1/2)	
RNP 0.30 DA		384-5/8	341 (400-5/8)	

AUTHORIZATION REQUIRED

SC-3, 30 OCT 2025 to 27 NOV 2025

SC-3, 30 OCT 2025 to 27 NOV 2025