
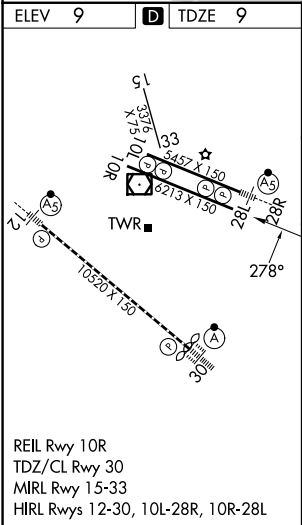
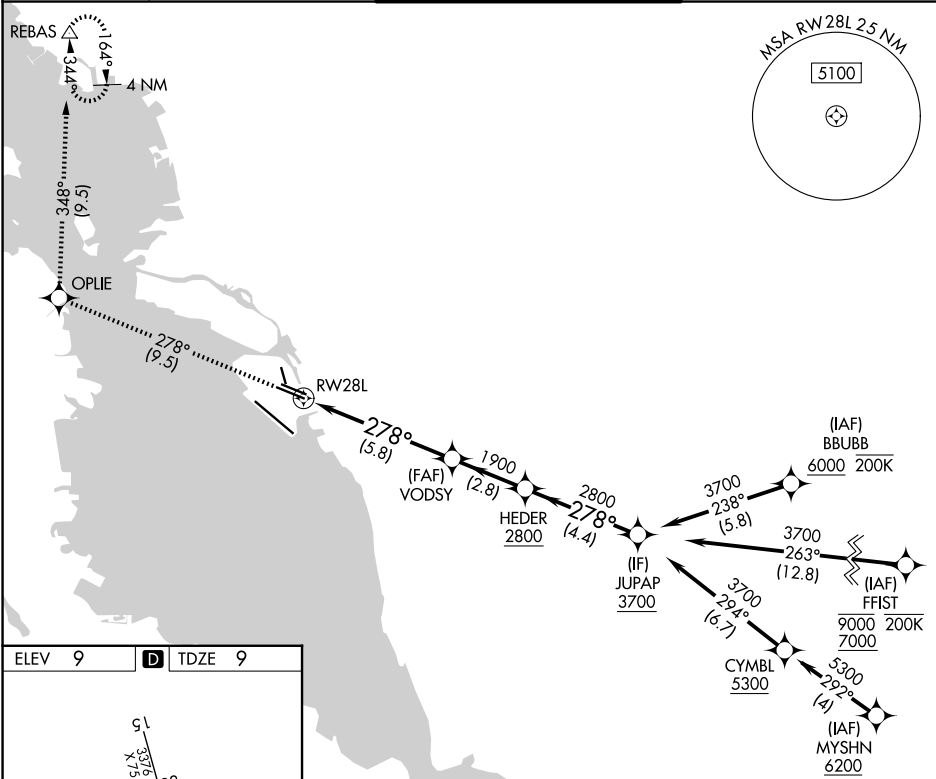


APP CRS	Rwy Ldg	6213
278°	TDZE	9
	Apt Elev	9

RNAV (RNP) Z RWY 28L
OAKLAND SAN FRANCISCO BAY (OAK)

RNP AR APCH - GPS. Authorization required.		MISSED APPROACH: Climb to 3000 on track 278° to OPLIE and on track 348° to REBAS and hold.	
▼ For uncompensated Baro-VNAV systems, procedure NA below 2°C or above 54°C.			
D-ATIS 133.775	NORCAL APP CON 125.35 263.15	OAKLAND TOWER 118.3 291.65 (10L/R-28L/R, 15-33) 127.2 256.9 (12-30)	GND CON 121.9 (10L/R-28L/R, 15-33) 121.75 (12-30)



3000	OPLIE	REBAS	VGSI and RNAV glidepath not coincident (VGSI Angle 3.00°/TCH 50).			JUPAP
 tr 278°	 tr 348°		VODSY	HEDER	 3700	
			1900		GP 3.00° TCH 55	
5.8 NM			2.8 NM	4.4 NM		
CATEGORY	A	B	C	D		
RNP 0.10 DA	306/45 297 (300-%)					
RNP 0.15 DA	359/55 350 (400-1)					
RNP 0.30 DA	425/60 416 (500-1¼)					
AUTHORIZATION REQUIRED						

SW-2, 27 NOV 2025 to 25 DEC 2025

SW-2, 27 NOV 2025 to 25 DEC 2025