



WAAS CH 86418 W12A	APP CRS 116°	Rwy Ldg 10000 TDZE 9 Apt Elev 9
--	------------------------	--

RNAV (GPS) Y RWY 12

OAKLAND SAN FRANCISCO BAY (OAK)

▼ ▲ For uncompensated Baro-VNAV systems, LNAV/VNAV NA below 0°C (32°F) or above 54°C (130°F). DME/DME RNP-0.3 NA. # RVR 1800 authorized with use of FD or AP or HUD to DA.	MALSR 	MISSED APPROACH: Climb direct HISIS to cross HISIS at or below 1600, then climb to 5400 on track 111° to DECOT and hold, continue climb-in-hold to 5400.
---	-----------	--

D-ATIS 133.775	NORCAL APP CON 125.35 263.15	OAKLAND TOWER 118.3 291.65 (10L/R-28L/R, 15-33) 127.2 256.9 (12-30)	GND CON 121.9 (10L/R-28L/R, 15-33) 121.75 (12-30)
--------------------------	--	---	---

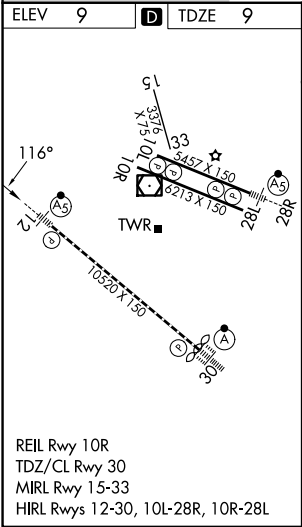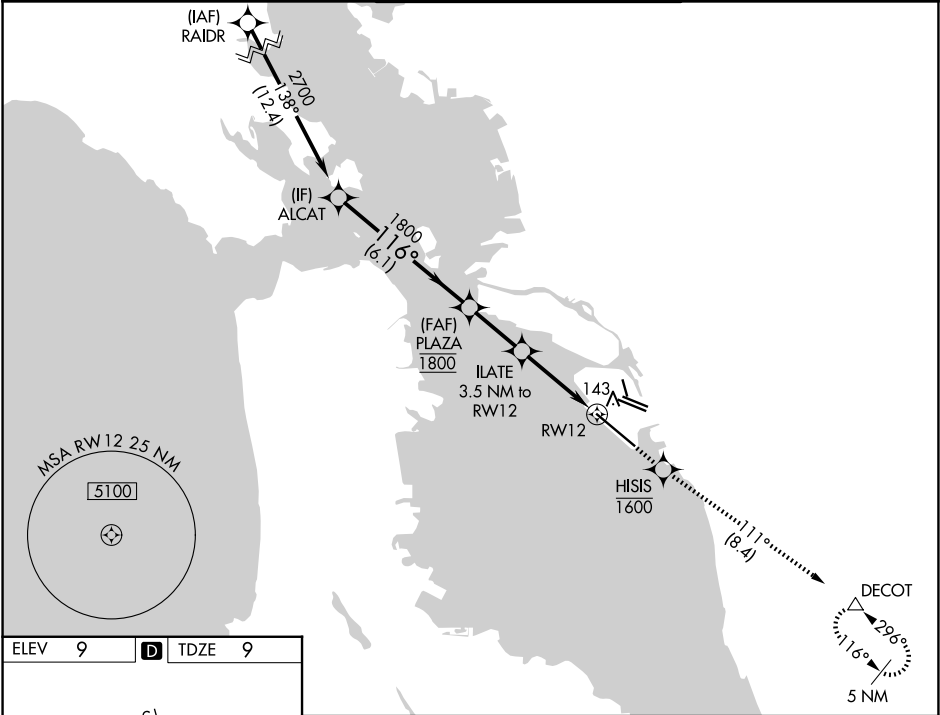

VGSI and RNAV glidepath not coincident (VGSI Angle 2.75/TCH 70).			
ALCAT			
2700			
GP 2.75° TCH 55			
PLAZA			
1800			
ILATE			
3.5 NM to RW12			
*1080			
*1 NM to RW12			
RW12			
*LNAV only.			
HISIS			
1600			
5400			
tr 111°			
DECOT			
△			
5 NM			
296°			
116°			
6.1 NM			
2.5 NM			
1 NM			
CATEGORY			
A B C D			
LPV DA#			
209/24 200 (200-½)			
LNAV/ VNAV DA			
304/27 295 (300-⅝)			
LNAV MDA			
360/24 351 (400-½) 360/30 351 (400-⅝)			
CIRCLING			
560-1 551 (600-1) 660-1¾ 651 (700-1¾) 1380-3 1371 (1400-3)			