
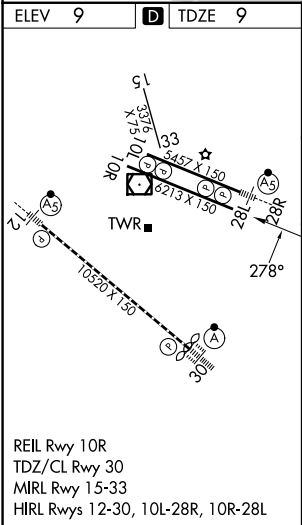


APP CRS	Rwy Ldg	6213
278°	TDZE	9
	Apt Elev	9

RNAV (RNP) Z RWY 28L
OAKLAND SAN FRANCISCO BAY (OAK)

RNP AR APCH - GPS. Authorization required.		MISSED APPROACH: Climb to 3000 on track 278° to OPLIE and on track 348° to REBAS and hold.	
▼ For uncompensated Baro-VNAV systems, procedure NA below 2°C or above 54°C.			
D-ATIS 133.775	NORCAL APP CON 125.35 263.15	OAKLAND TOWER 118.3 291.65 (10L/R-28L/R, 15-33) 127.2 256.9 (12-30)	GND CON 121.9 (10L/R-28L/R, 15-33) 121.75 (12-30)

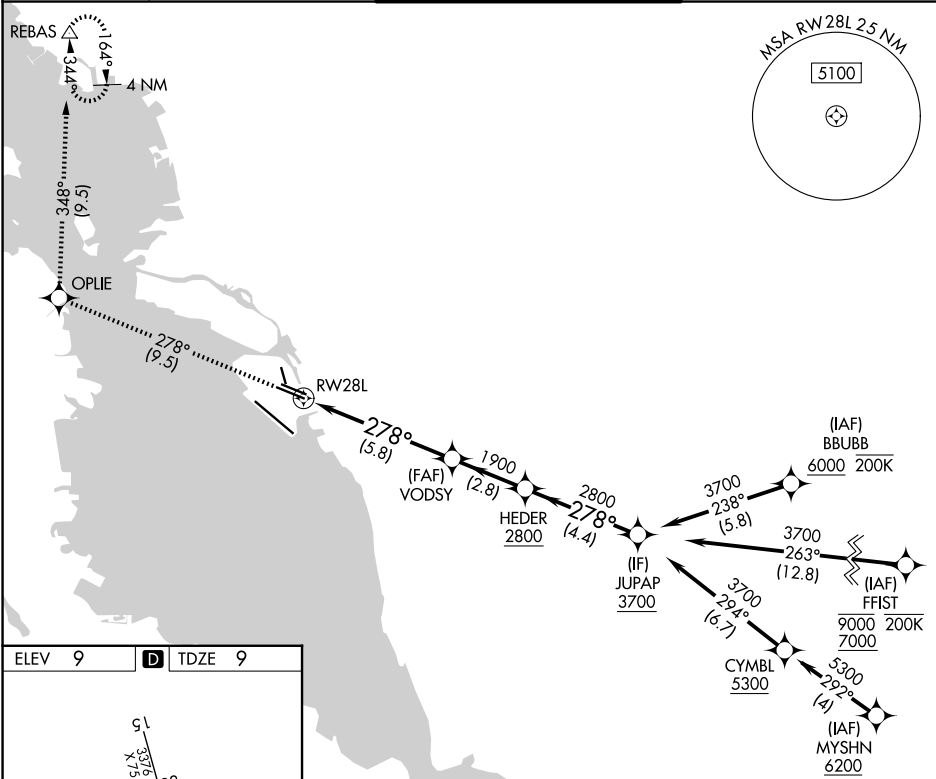

ELEV 9		D	TDZE 9
3000		OPLIE	REBAS
tr 278°		tr 348°	
RW28L		VODSY	HEDER
1900		2800	3700
5.8 NM		2.8 NM	4.4 NM
CATEGORY	A	B	C
RNP 0.10 DA	306/45	297 (300-%)	
RNP 0.15 DA	359/55	350 (400-1)	
RNP 0.30 DA	425/60	416 (500-1½)	
AUTHORIZATION REQUIRED			