

APP CRS
355°

Rwy Ldg 12250
TDZE 496
Apt Elev 542

RNAV (RNP) Z RWY 36L
AUSTIN-BERGSTROM INTL (AUS)



RNP AR APCH. RADAR required.

▼ Simultaneous approach authorized. For uncompensated Baro-VNAV systems, procedure NA below -5°C or above 54°C. For inop ALS, increase RNP 0.11 all Cats visibility to RVR 4500 and RNP 0.30 all Cats visibility to RVR 5500.

MALS
A4

MISSED APPROACH: Climb to 1700 then climbing left turn to 3500 direct GARDS and hold.

D-ATIS 124.4	AUSTIN APP CON 127.225 317.65 (E) 120.875 270.25 (S) 119.0 370.85 (W)	AUSTIN TOWER 121.0 281.5	GND CON 121.9 348.6
-----------------	--	-----------------------------	------------------------

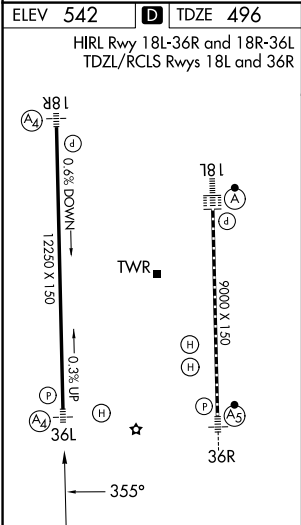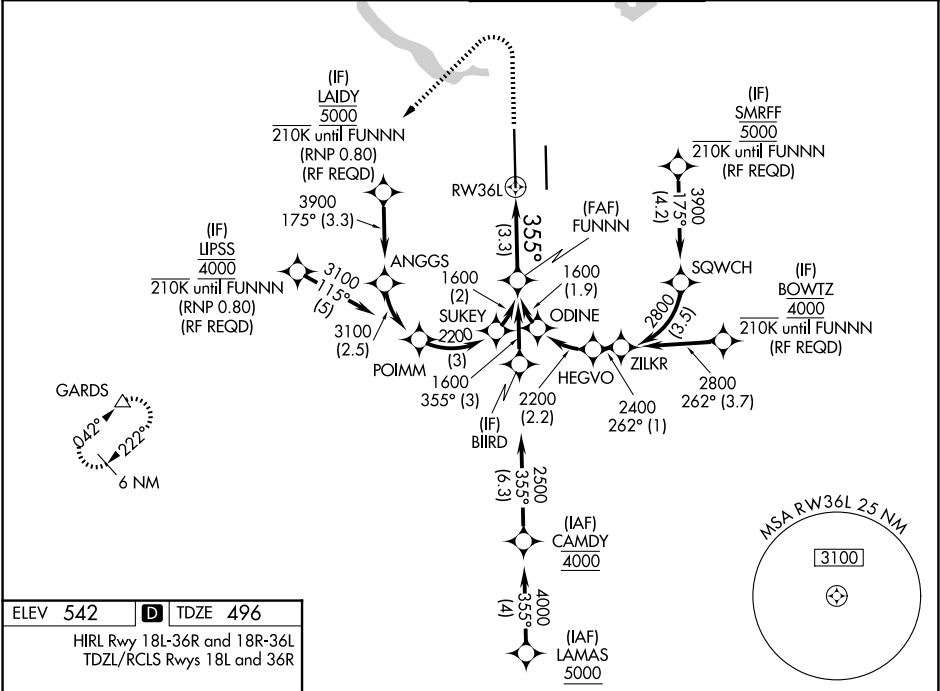

1700 3500 GARDS

VGSI and RNAV glidepath not coincident (VGSI Angle 3.00/TCH 60).

RW36L

See planview for multiple IF locations.

3.3 NM

GP 3.00° TCH 54

CATEGORY	A	B	C	D
RNP 0.11 DA	758/40	262 (300-¾)		
RNP 0.30 DA	858/40	362 (400-¾)		

AUTHORIZATION REQUIRED