

APP CRS	Rwy Ldg	7701
317°	TDZE	24
	Apt Elev	29

RNAV (RNP) Y RWY 32


JACKSONVILLE INTL (JAX)

▼

For uncompensated Baro-VNAV systems, procedure NA below -5°C (23°F) or above 54°C (130°F). GPS required.

MISSED APPROACH: Climb to 2000 on track 317° to OSBAJ and hold.

D-ATIS 125.85	JACKSONVILLE APP CON 119.0 269.9	JACKSONVILLE TOWER 118.3 317.7	GND CON 121.9 348.6
------------------	-------------------------------------	-----------------------------------	------------------------

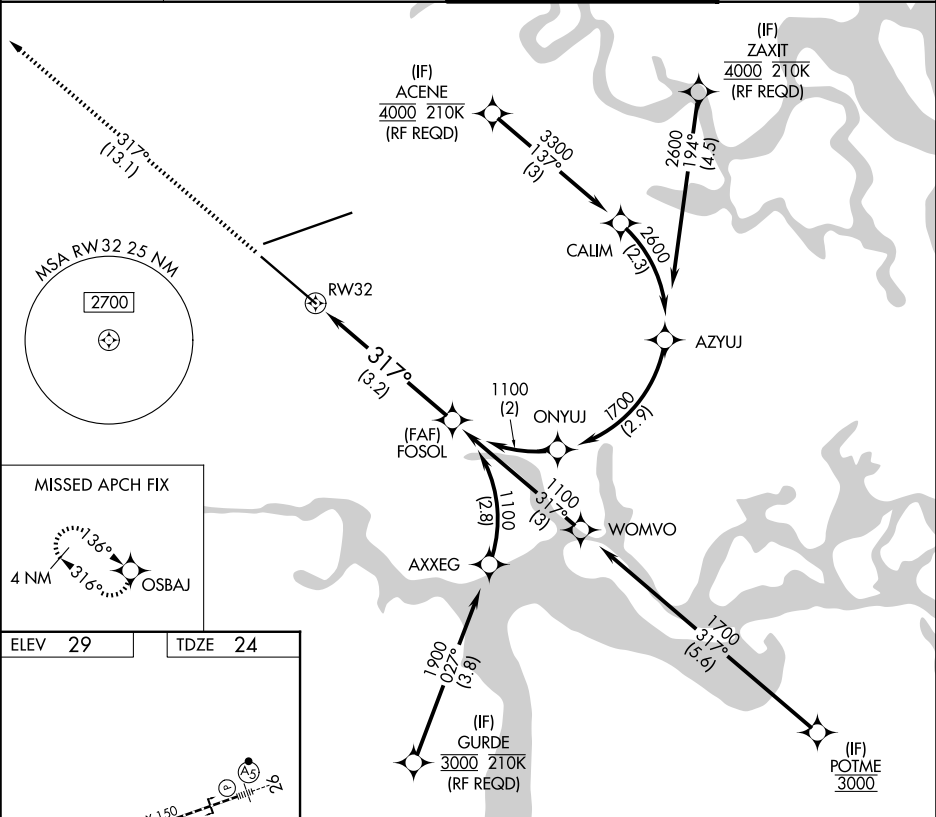

ELEV 29

TDZE 24

REIL Rwy 32
TDZL/RCLS Rwy 8, 14, and 26
HIRL Rwy 8-26 and 14-32

2000 OSBAJ

VGSI and RNAV glidepath not coincident (VGSI Angle 3.00/TCH 67).

FOSOL 1100

RW32 317°

GP 3.00° TCH 50

See planview for multiple IF locations.

3.2 NM

CATEGORY	A	B	C	D
RNP 0.11 DA		359-1 1/8	334 (400-1 1/8)	
RNP 0.30 DA		423-1 3/8	399 (400-1 3/8)	

AUTHORIZATION REQUIRED