

APP CRS	Rwy Ldg	10201
303°	TDZE	1380
	Apt Elev	1384

RNAV (RNP) Z RWY 30C


MESA GATEWAY (IWA)

▼

For uncompensated Baro-VNAV systems, procedure NA below -17°C (2°F) or above 54°C (130°F). GPS and RF required.

MISSED APPROACH: Climb to 2800 then climbing left turn to 5000 direct GICGE and hold.

ATIS 133.5 270.275	PHOENIX APP CON 124.9 353.8	GATEWAY TOWER ★ 120.6 (CTAF) 289.4	GND CON 128.25 275.8
-----------------------	--------------------------------	---------------------------------------	-------------------------

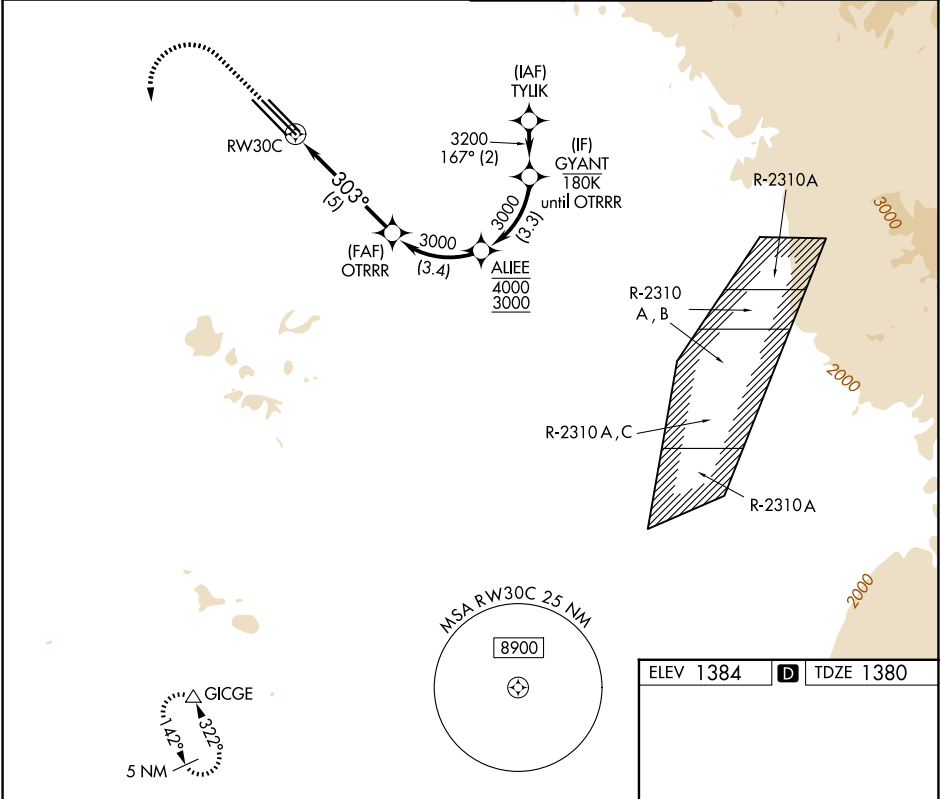

2800	5000	GICGE	VGSI and RNAV glidepath not coincident (VGSI Angle 3.00/TCH 49).	GYANT
↑	↘	△		
CATEGORY	A	B	C	D
RNP 0.21 DA	1637-7/8		257 (300-7/8)	
RNP 0.30 DA	1711-1 1/8		331 (400-1 1/8)	
AUTHORIZATION REQUIRED				