
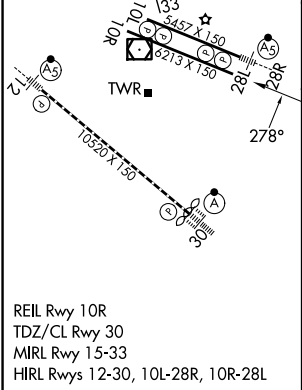


APP CRS	Rwy Ldg	6213
278°	TDZE	9
	Apt Elev	9

RNAV (RNP) Z RWY 28L
OAKLAND SAN FRANCISCO BAY (OAK)

RNP AR APCH - GPS. Authorization required.		MISSED APPROACH: Climb to 3000 on track 278° to OPLIE and on track 348° to REBAS and hold.	
▼ For uncompensated Baro-VNAV systems, procedure NA below 2°C or above 54°C.			
D-ATIS 133.775	NORCAL APP CON 125.35 263.15	OAKLAND TOWER 118.3 291.65 (10L/R-28L/R, 15-33) 127.2 256.9 (12-30)	GND CON 121.9 (10L/R-28L/R, 15-33) 121.75 (12-30)

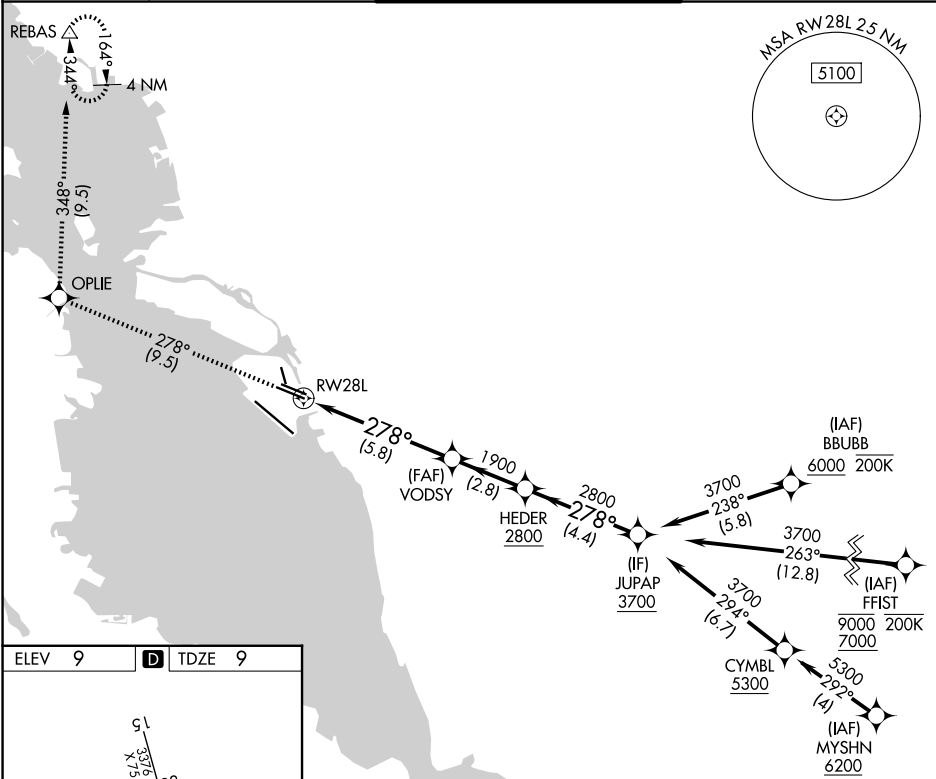

3000		OPLIE		tr 278°		tr 348°		REBAS		△		VGSI and RNAV glidepath not coincident (VGSI Angle 3.00°/TCH 50).		JUPAP			
												VODSY		HEDER		3700	
												1900		278°		2800	
												1900				GP 3.00° TCH 55	
												5.8 NM		2.8 NM		4.4 NM	
CATEGORY		A		B		C		D									
RNP 0.10 DA				306/45		297 (300-%)											
RNP 0.15 DA				359/55		350 (400-1)											
RNP 0.30 DA				425/60		416 (500-1½)											
AUTHORIZATION REQUIRED																	

AUTHORIZATION REQUIRED