

APP CRS
296°

Rwy Ldg **10000**
TDZE **9**
Apt Elev **9**

RNAV (RNP) Z RWY 30
OAKLAND SAN FRANCISCO BAY (OAK)

RNP AR APCH - GPS. Authorization required. From ALLXX or PARBB: RF.


ALSF-2

MISSED APPROACH: Climb to 4000 on track 296° to PLAZA and on track 282° to SAU VOR/DME and hold, continue climb-in-hold to 4000.

RADAR required.

For uncompensated Baro-VNAV systems, procedure NA below 2°C or above 54°C. For inop ALS, increase RNP 0.15 all Cats visibility to RVR 4500 and increase RNP 0.30 all Cats visibility to RVR 5500.

D-ATIS 133.775	NORCAL APP CON 125.35 263.15	OAKLAND TOWER 118.3 291.65 (10L/R-28L/R, 15-33) 127.2 256.9 (12-30)	GND CON 121.9 (10L/R-28L/R, 15-33) 121.75 (12-30)
--------------------------	--	---	---

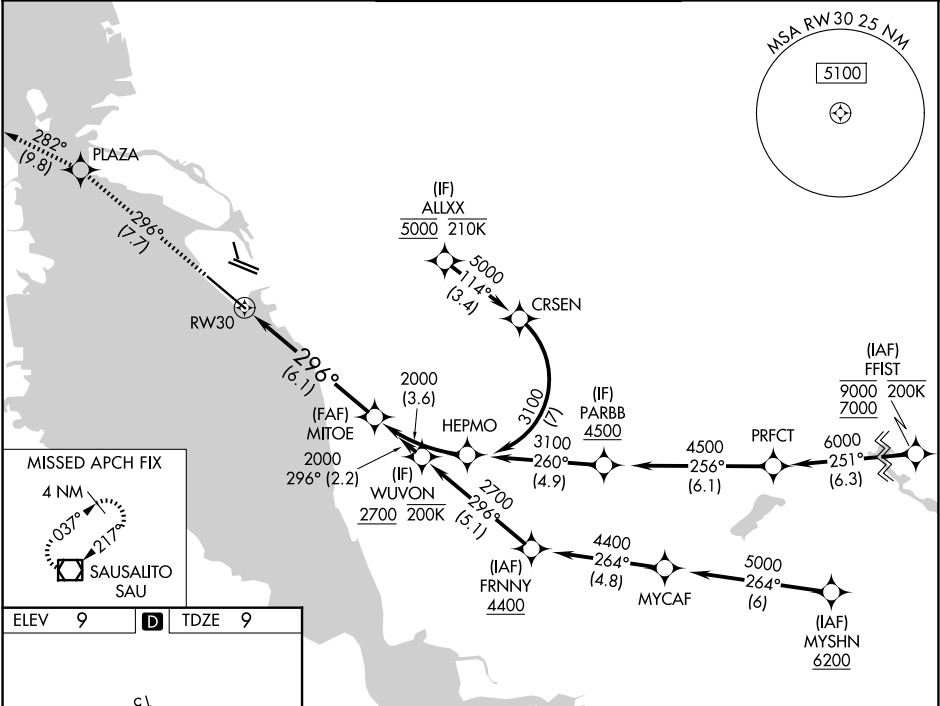

ELEV 9

D

TDZE 9

REIL Rwy 10R
TDZ/CL Rwy 30
MIRL Rwy 15-33
HIRL Rwys 12-30, 10L-28R, 10R-28L

4000

PLAZA

tr 296°

tr 282°

SAU

MITOE 2000

VGSI and RNAV glidepath not coincident (VGSI Angle 3.00/TCH 71).

RW30

296°

See planview for multiple IF locations.

6.1 NM

GP 3.00° TCH 55

CATEGORY	A	B	C	D
RNP 0.15 DA		281/24	272 (300-½)	
RNP 0.30 DA		385/35	376 (400-⅔)	

AUTHORIZATION REQUIRED