
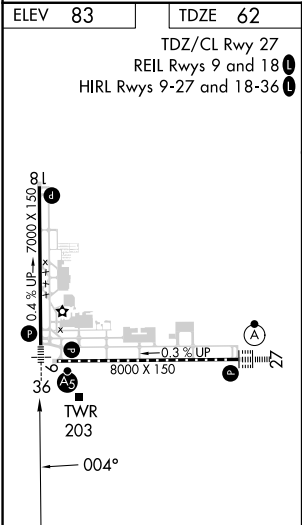


LOC/DME I-TLH 110.3 Chan 40	APP CRS 004°	Rwy Ldg 7000 TDZE 62 Apt Elev 83
---	------------------------	---

ILS Z or LOC Z RWY 36
Tallahassee Intl (TLH)

DME required. RADAR required for procedure entry at CVILL.	MALSR 	MISSED APPROACH: Climb to 4000 direct SZW VORTAC and hold, continue climb-in-hold to 4000.
ASR * RVR 1800 authorized with use of FD or AP or HUD to DA.		

ATIS 119.45 239.25	Tallahassee APP CON ★ 135.8 317.4	Tallahassee Tower ★ 118.7 (CTAF) 0 257.8	GND CON 121.9 348.6	UNICOM 123.075
------------------------------	---	--	-------------------------------	--------------------------

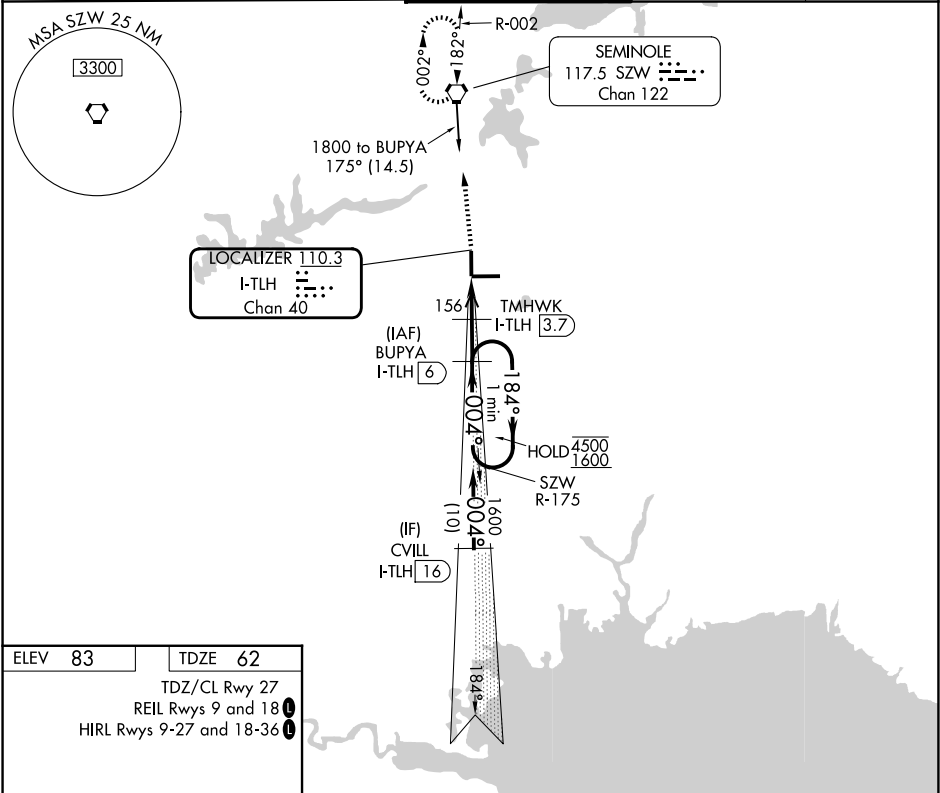

4000 SZW ↑ ⬡	BUPLYA I-TLH 6 One Minute Holding Pattern TMHVK I-TLH 3.7 1600 184° → 4500 ← 004° 1600 004° 880 1600 GS 3.00° TCH 54 2.4 NM 2.3 NM			
CATEGORY	A	B	C	D
S-ILS 36 *	262/24		200 (200-½)	
S-LOC 36	460/24	398 (400-½)	460/35	398 (400-¾)
CIRCLING	580-1 497 (500-1)	600-1 517 (600-1)	640-1½ 557 (600-1½)	800-2¼ 717 (800-2¼)

SE-3, 22 JAN 2026 to 19 FEB 2026

SE-3, 22 JAN 2026 to 19 FEB 2026