

LOC/DME I-PUK 111.15 Chan 48 (Y)	APP CRS 162°	Rwy Ldg TDZE 10000 69 Apt Elev 69
---	------------------------	--




ILS RWY 16 (SA CAT I & II)

NORTHWEST FLORIDA BEACHES INTL (ECP)

DME required for procedure entry. DME required.
 ▼ SA CAT I: Requires specific OPSPEC, MSPEC, or LOA approval and use of HUD to DH.
 ▲ SA CAT II: Reduced lighting: requires specific OPSPEC, MSPEC, or LOA approval and use of autoland or HUD to touchdown.

MALSRS
 MISSED APPROACH: Climb to 600 then climbing left turn to 4000 on heading 025° and on MAI VORTAC R-237 to OUISS INT/MAI 33 DME and hold, continue climb-in-hold to 4000.

ATIS 119.975	TYNDALL APP CON★ 125.2	PANAMA CITY TOWER★ 118.95 (CTAF) 0	GND CON 121.65
------------------------	----------------------------------	--	--------------------------

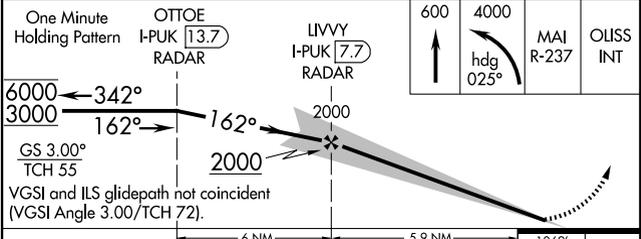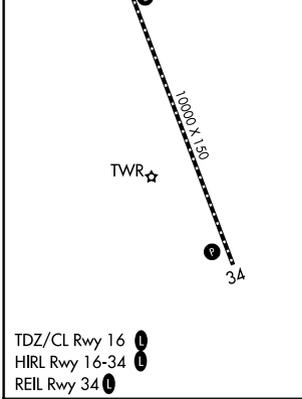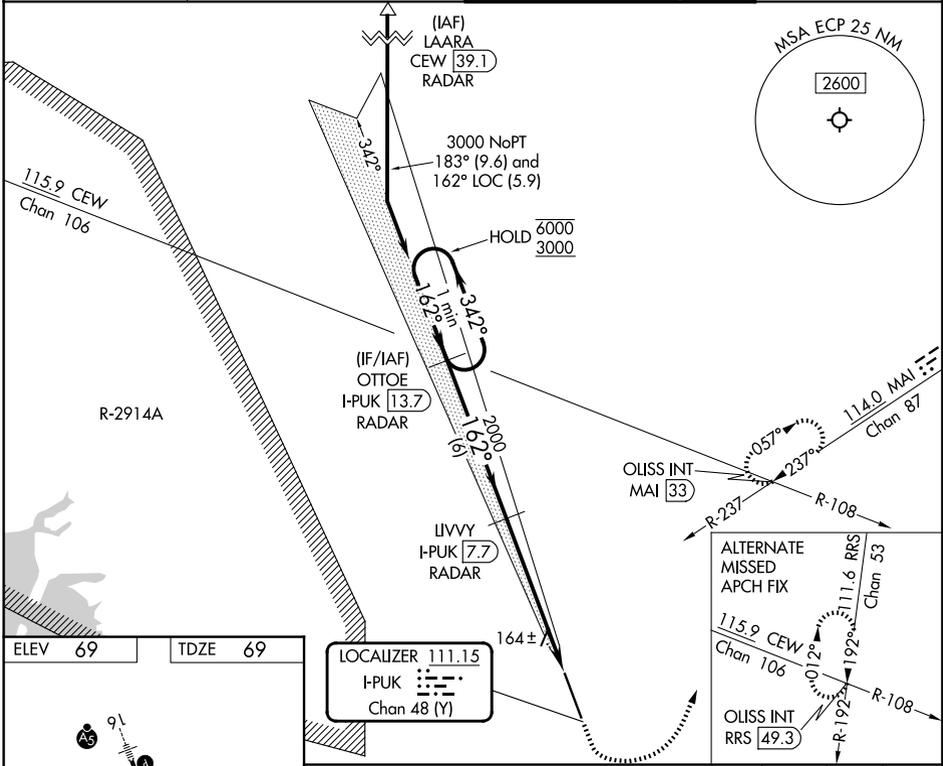

CATEGORY	A	B	C	D
S-ILS 16	SA CAT I RA 151/14 150 DA 219			
S-ILS 16	SA CAT II RA 101/12 100 DA 169			

SA CATEGORY I & II ILS - SPECIAL AIRCREW & AIRCRAFT CERTIFICATION REQUIRED

SE-3, 19 MAR 2026 to 16 APR 2026

SE-3, 19 MAR 2026 to 16 APR 2026