



APP CRS 278°	Rwy Ldg TDZE Apt Elev	6213 9 9
------------------------	-----------------------------	-------------------------------------

RNAV (RNP) Z RWY 28L

OAKLAND SAN FRANCISCO BAY (OAK)

RNP AR APCH - GPS. Authorization required.		OAKLAND TOWER		GND CON	
▼ For uncompensated Baro-VNAV systems, procedure NA below 2°C or above 54°C.		118.3 291.65 (10L/R-28L/R, 15-33) 127.2 256.9 (12-30)		121.9 (10L/R-28L/R, 15-33) 121.75 (12-30)	
D-ATIS 133.775	NORCAL APP CON 125.35 263.15				

MISSED APPROACH: Climb to 3000 on track 278° to OPLIE and on track 348° to REBAS and hold.

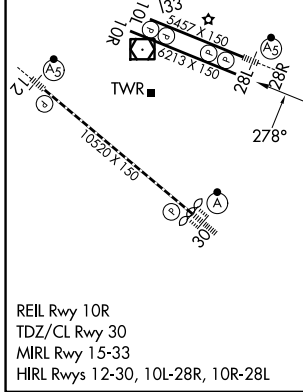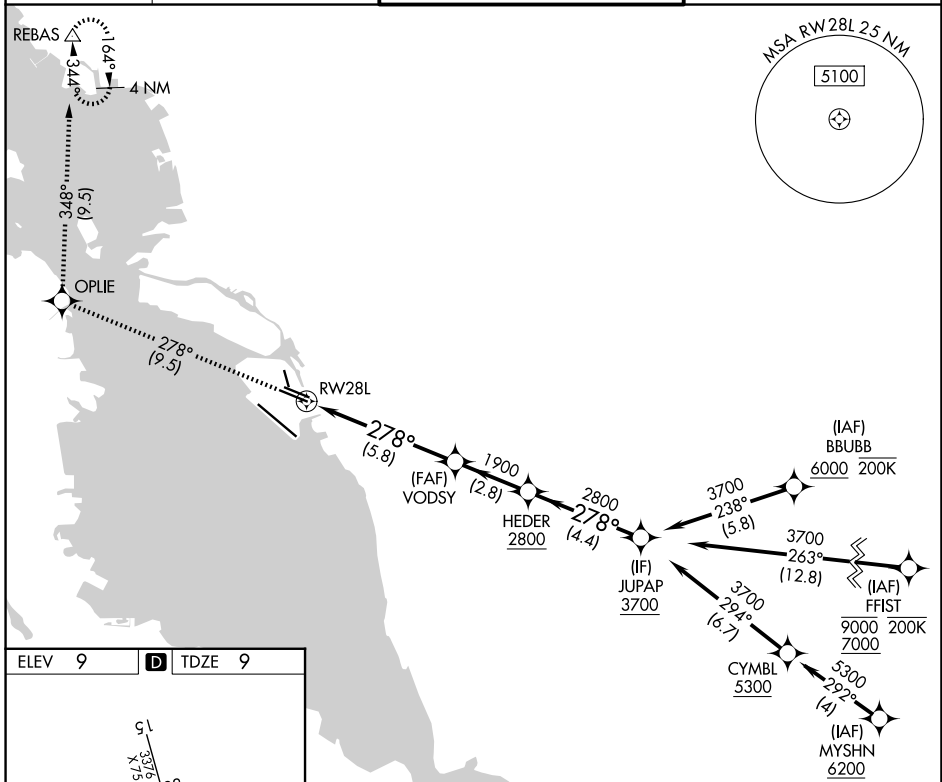

ELEV 9	D	TDZE 9
3000	OPLIE	tr 278°
	REBAS	tr 348°
VGSI and RNAV glidepath not coincident (VGSI Angle 3.00/TCH 50).		
	VODSY	HEDER
	1900	2800
	5.8 NM	2.8 NM
		4.4 NM
		JUPAP
		3700
		GP 3.00°
		TCH 55
CATEGORY	A	B
RNP 0.10 DA		306/45 297 (300-¾)
RNP 0.15 DA		359/55 350 (400-1)
RNP 0.30 DA		425/60 416 (500-1¼)

AUTHORIZATION REQUIRED

SW-2, 11 JUN 2026 to 09 JUL 2026

SW-2, 11 JUN 2026 to 09 JUL 2026