
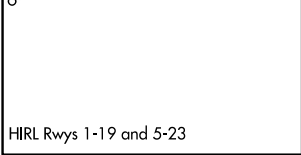
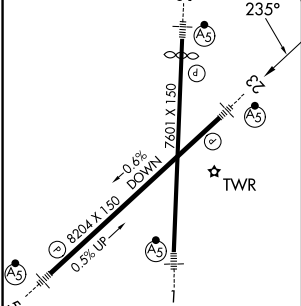


WAAS CH 90220 W23A	APP CRS 235°	Rwy Ldg TDZE 1226 Apt Elev 1226
--	------------------------	---

RNAV (GPS) RWY 23
AKRON-CANTON RGNL (CAK)

▼ For uncompensated Baro-VNAV systems, LNAV/VNAV NA below -17°C (2°F) or above 46°C (114°F). DME/DME RNP-0.3 NA. For inoperative MALSR, increase LNAV Cat D visibility to RVR 6000. ** RVR 1800 authorized with use of FD or AP or HUD to DA.	MALSR 	MISSED APPROACH: Climb to 3000 direct CICEE and on track 147° to BSV VOR/DME and hold.
---	--	---

ATIS 121.05	CLEVELAND APP CON★ 125.5 269.25	AKRON-CANTON TOWER 134.75 279.575	GND CON 121.7 348.6
-----------------------	---	---	-------------------------------

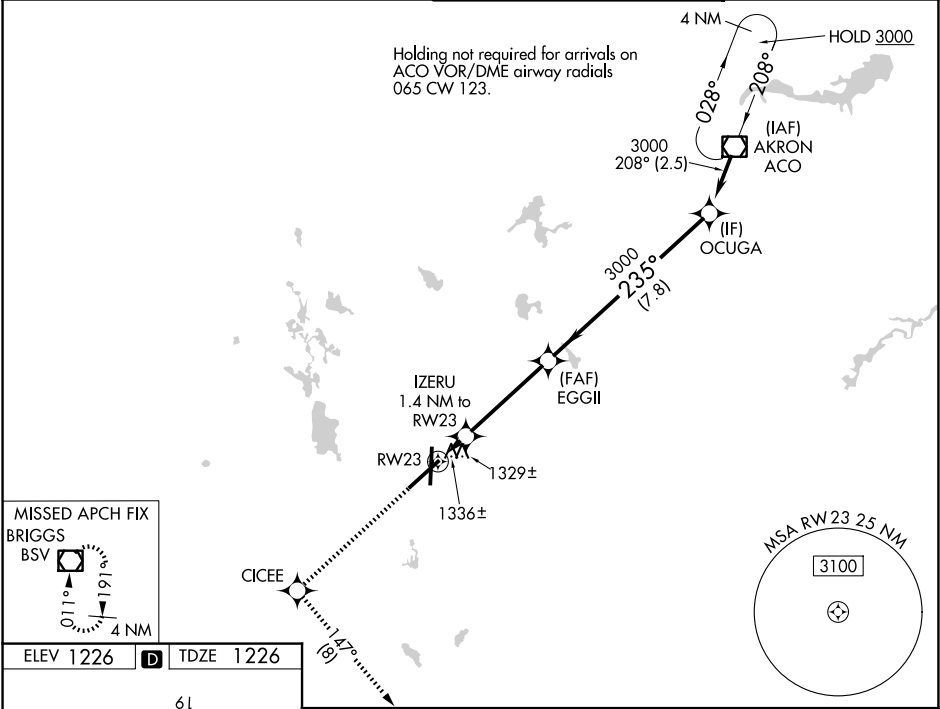

3000	CICEE	tr 147°	BSV			Procedure Turn NA