
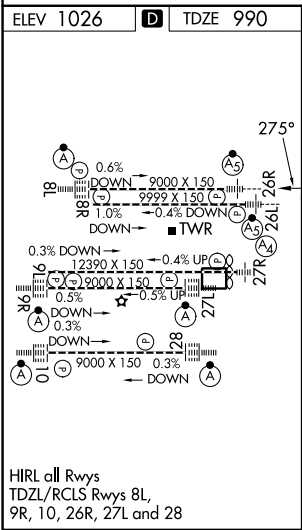
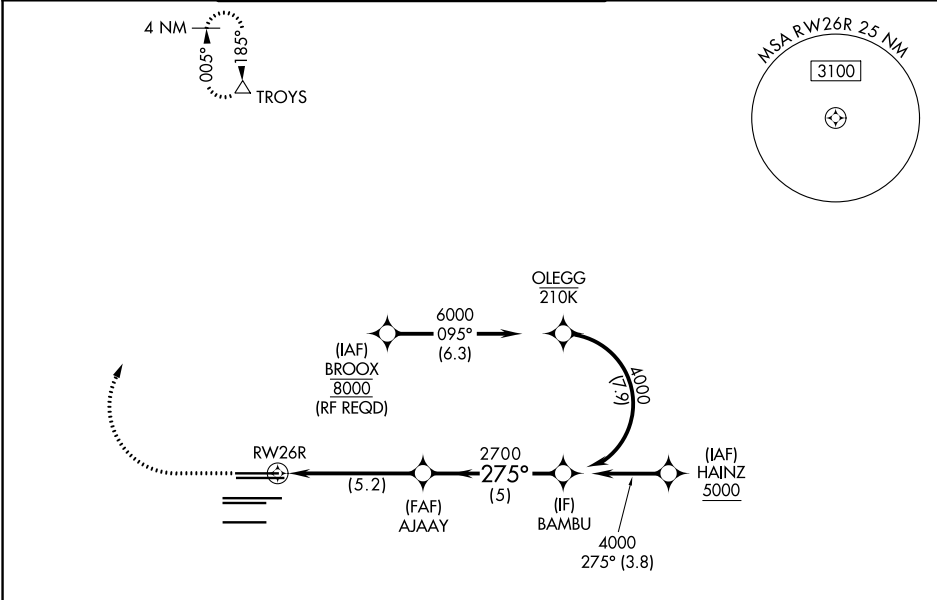


APP CRS	Rwy Ldg	8500
275°	TDZE	990
	Apt Elev	1026

RNAV (RNP) Z RWY 26R
HARTSFIELD/JACKSON ATLANTA INTL (ATL)

▼ For uncompensated Baro-VNAV systems, procedure NA below -8°C (18°F) or above 54°C (130°F). GPS required. Simultaneous approach authorized. Arrival from BROOX NA during simultaneous triple approaches.		MALSR 	MISSED APPROACH: Climb to 1500 then climbing right turn to 3500 direct TROYS and hold.	
D-ATIS 119.65	ATLANTA APP CON 134.725 379.9	ATLANTA TOWER 8L-26R 8R-26L 9L-27R 9R-27L 10-28 RWYS 119.1 125.325 123.85 119.3 119.5 254.4	ALL RWYS 121.9	GND CON ALL RWYS 121.75 121.65 254.4

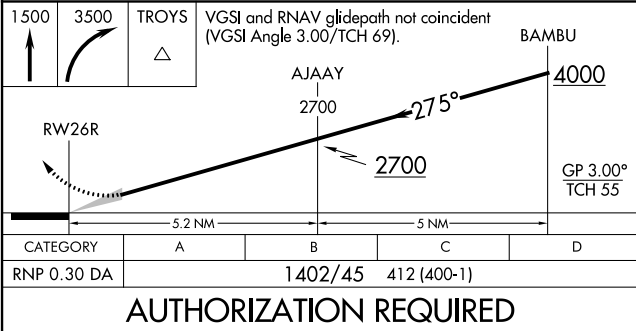

1500	3500	TROYS	VGSi and RNAV glidepath not coincident (VGSi Angle 3.00/TCH 69).			
						
RW26R			AJAAY 2700	BAMBU 4000	GP 3.00° TCH 55	
5.2 NM			5 NM			
CATEGORY	A		B	C	D	
RNP 0.30 DA	1402/45		412 (400-1)			
AUTHORIZATION REQUIRED						