
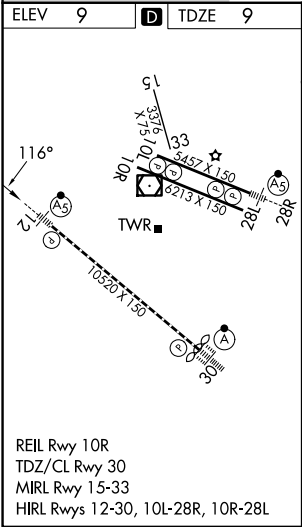


WAAS CH 86418 W12A	APP CRS 116°	Rwy Ldg 10000 TDZE 9 Apt Elev 9
--	------------------------	--

RNAV (GPS) Y RWY 12
OAKLAND SAN FRANCISCO BAY (OAK)

▼ ▲	For uncompensated Baro-VNAV systems, LNAV/VNAV NA below 0°C (32°F) or above 54°C (130°F). DME/DME RNP-0.3 NA. # RVR 1800 authorized with use of FD or AP or HUD to DA.	MALSR 	MISSED APPROACH: Climb direct HISIS to cross HISIS at or below 1600, then climb to 5400 on track 111° to DECOT and hold, continue climb-in-hold to 5400.
----------------------	---	-----------	--

D-ATIS 133.775	NORCAL APP CON 125.35 263.15	OAKLAND TOWER 118.3 291.65 (10L/R-28L/R, 15-33) 127.2 256.9 (12-30)	GND CON 121.9 (10L/R-28L/R, 15-33) 121.75 (12-30)
--------------------------	--	---	---

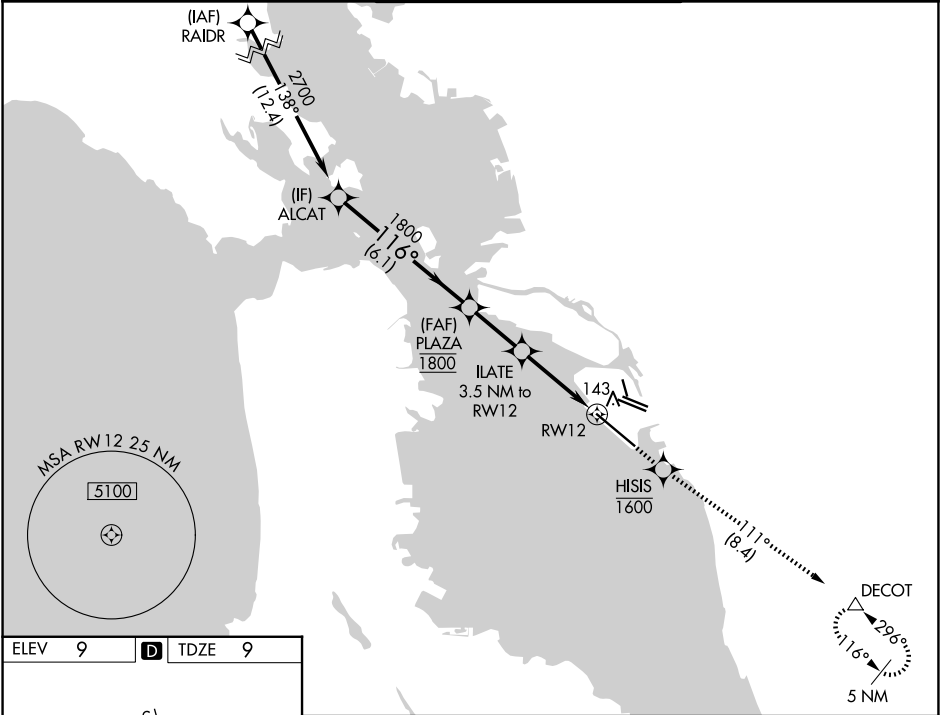

VGSI and RNAV glidepath not coincident (VGSI Angle 2.75/TCH 70).			
ALCAT			
PLAZA			
ILATE			
HISIS			
DECOT			
*LNAV only.			
GP 2.75° TCH 55			
CATEGORY			
LPV DA#			
LNAV/VNAV DA			
LNAV MDA			
CIRCLING			