

WAAS CH 40017 W10A	APP CRS 100°	Rwy Ldg TDZE 421 Apt Elev 421
--	------------------------	---

RNAV (GPS) Z RWY 10

SYRACUSE HANCOCK INTL (SYR)

RNP APCH - GPS.


For uncompensated Baro-VNAV systems, LNAV/VNAV NA below -19°C or above 54°C. For inop ALS, increase LNAV Cats C/D visibility to RVR 5500. # RVR 1800 authorized with use of FD or AP or HUD to DA.

MALSR



MISSED APPROACH: Climb to 3200 direct STODA and hold, continue climb-in-hold to 3200.

ATIS 124.225	SYRACUSE APP CON 126.125 269.125	SYRACUSE TOWER 120.3 239.0	GND CON 121.7 348.6
------------------------	--	--------------------------------------	-------------------------------

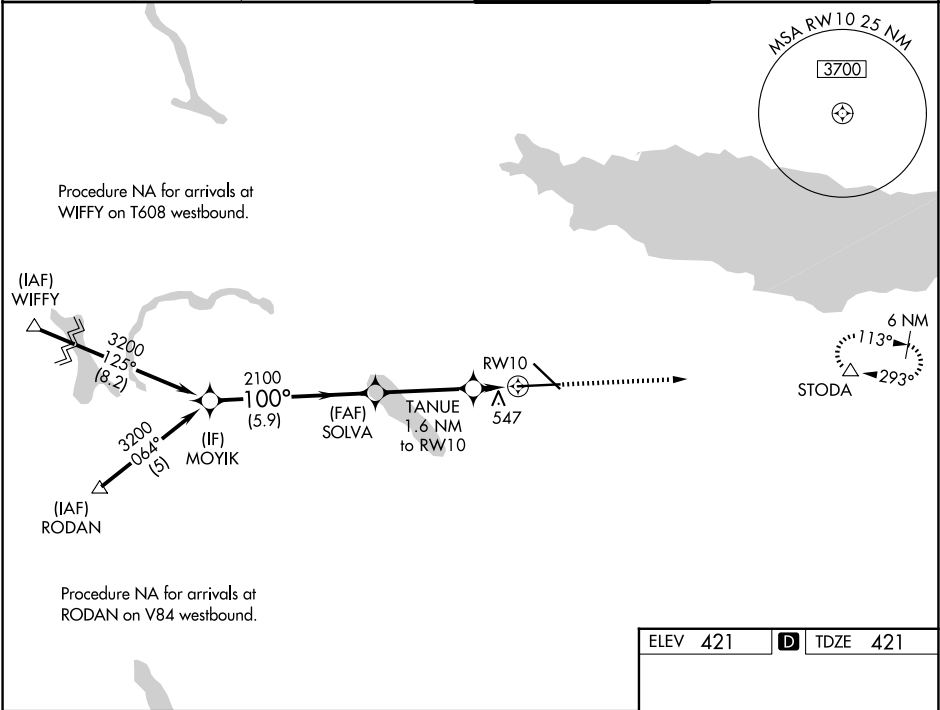

MOYIK

3200

GP 3.00°

TCH 55

SOLVA

2100

2100

TANUE

1.6 NM to RW10

*1 NM to RW10

RW10

3200

STODA

↑

△

*LNAV only

100°

*980

5.9 NM

3.5 NM

0.6 NM

1 NM

CATEGORY	A	B	C	D
LPV DA#	621/24 200 (200-½)			
LNAV/VNAV DA	846/40 425 (500-¾)			
LNAV MDA	800/24 379 (400-½)	800/35 379 (400-¾)		
CIRCLING	900-1 479 (500-1)	920-1 499 (500-1)	1020-1½ 599 (600-1½)	1180-2½ 759 (800-2½)

