

WAAS CH 58020 W19A	APP CRS 189°	Rwy Ldg TDZE Apt Elev	7000 1218 1226
--	------------------------	-----------------------------	---

RNAV (GPS) RWY 19

AKRON-CANTON RGNL (CAK)

T


For uncompensated Baro-VNAV systems, LNAV/VNAV NA below -17°C (2°F) or above 46°C (114°F). DME/DME RNP-0.3 NA.
 ** RVR 1800 authorized with use of FD or AP or HUD to DA.

MALSR


MISSED APPROACH: Climb to 3000
direct HOMEV and on track 184° to
BSV VOR/DME and hold.

ATIS 121.05	CLEVELAND APP CON★ 125.5 269.25	AKRON-CANTON TOWER 134.75 279.575	GND CON 121.7 348.6
----------------	------------------------------------	--------------------------------------	------------------------

Holding not required for arrivals on
ACO VOR/DME airway radials
347 CW 185.

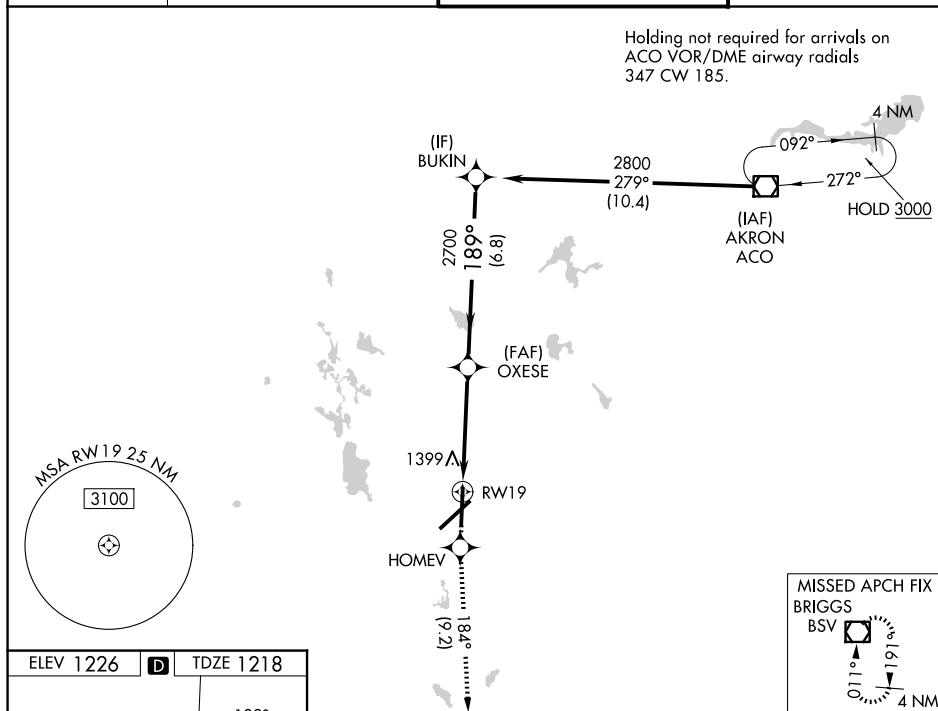

ELEV 1226	D	TDZE 1218
-----------	----------	-----------

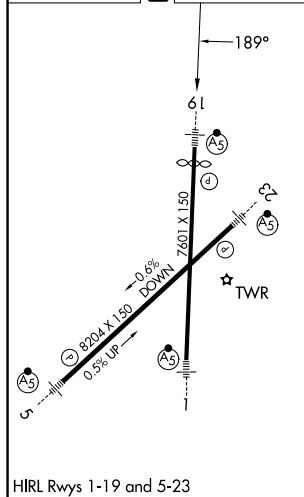

3000 ↑	HOMEV ✱	tr 184°	BSV ◻	Procedure Turn NA			
* LNAV only 				GP 3.00° TCH 53			
CATEGORY	A		B		C		D
LPV DA**			1418/24		200 (200-½)		
LNAV/ VNAV DA			1753-1½		535 (600-1½)		
LNAV MDA	1700/24		482 (500-½)		1700/40 482 (500-¾)	1700/50 482 (500-1)	
CIRCLING	1760-1		534 (600-1)		1780-1½ 554 (600-1½)	1800-2 574 (600-2)	