


APP CRS	Rwy Ldg	8598
168°	TDZE	25
	Apt Elev	27

RNAV (RNP) Z RWY 17R

SACRAMENTO INTL (SMF)

RNP AR APCH-GPS. ▼ For uncompensated Baro-VNAV systems, procedure NA below -2°C or above 54°C. For inop ALS, increase RNP 0.10 all Cats visibility to RVR 4000; increase RNP 0.18 all Cats visibility to RVR 4500 and RNP 0.30 all Cats visibility to RVR 5500.	ALSF-2 A	MISSED APPROACH: Climb to 500 then climbing right turn to 2000 direct GRIME and hold.
--	-------------	---

D-ATIS	NORCAL APP CON	CAPITOL TOWER	GND CON
126.75	125.4 259.1 (W-NE) 125.25 257.9 (SW) 127.4 317.5 (E-SE)	125.7 256.7	121.7 256.7

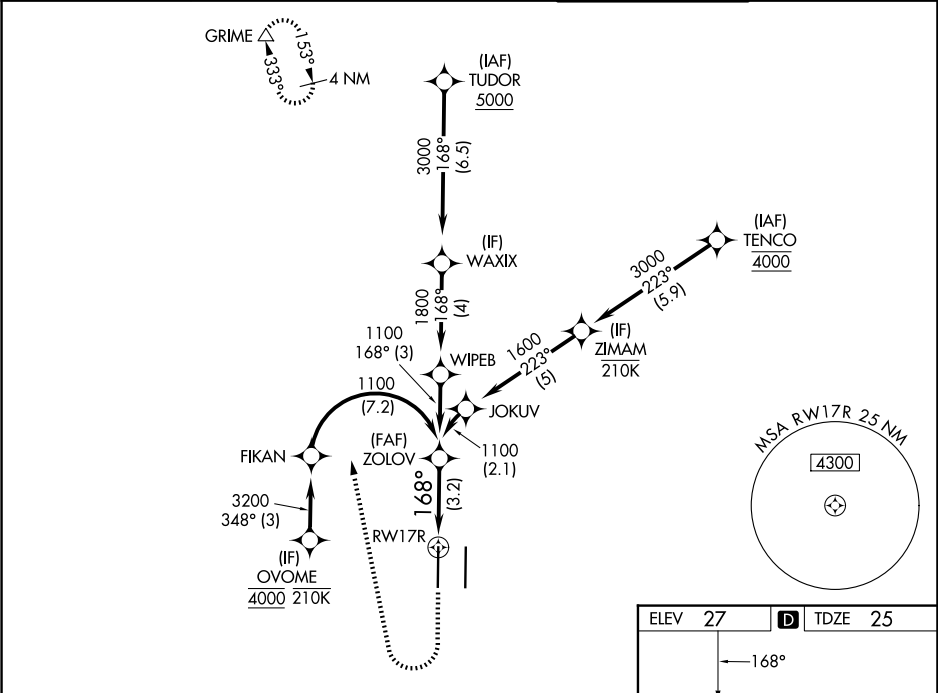

500	2000	GRIME	VGSI and RNAV glidepath not coincident (VGSI Angle 3.00/TCH 72).		
↑		△			
			See planview for multiple IF locations.		
			3.2 NM		
			GP 3.00° TCH 57		
CATEGORY	A	B	C	D	
RNP 0.10 DA	275/24 250 (300-½)				
RNP 0.18 DA	326/24 301 (300-½)				
RNP 0.30 DA	385/30 360 (400-⅔)				
AUTHORIZATION REQUIRED					

