

APP CRS
047°

Rwy Ldg
TDZE
Apt Elev
5000
8
8

RNAV (RNP) Z RWY 5
NAPLES MUNI (APF')


RNP AR APCH - GPS. Authorization required. From ISAJY or TIOFF: RF.

▼

For uncompensated Baro-VNAV systems, procedure NA below 6°C or above 50°C.

MISSED APPROACH: Climb to 500 then climbing right turn to 2100 direct EVRGD and hold.

ATIS 134.225	FORT MYERS APP CON★ 119.75 371.85 (W) 124.125 371.85 (E)	NAPLES TOWER★ 128.5 (CTAF) 0	GND CON 121.6
------------------------	--	--	-------------------------

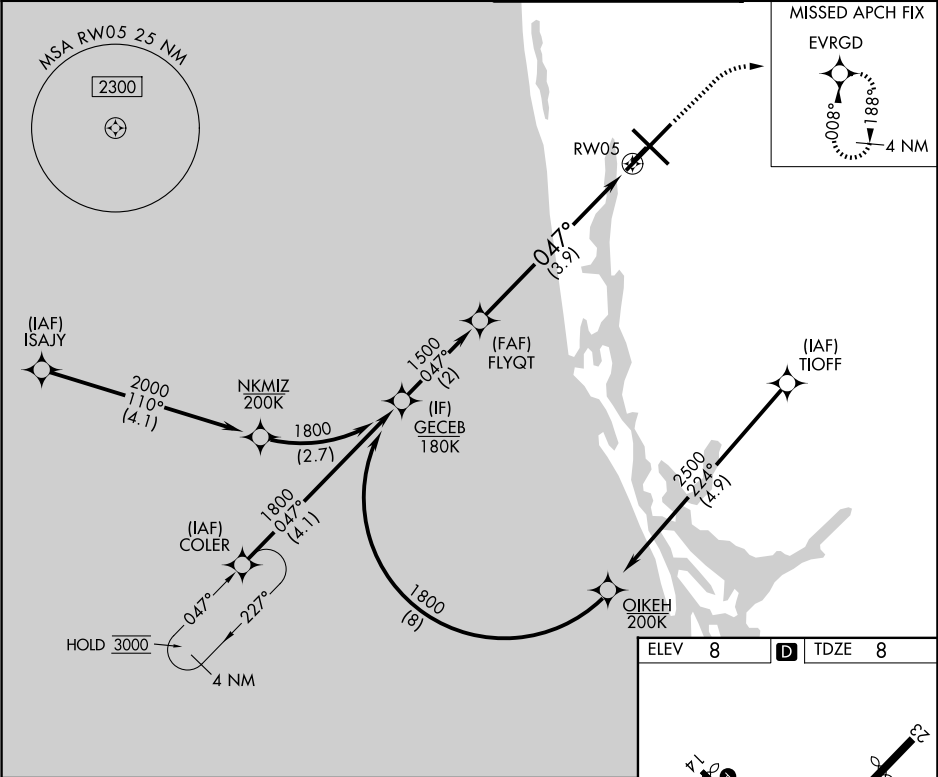

VGSI and RNAV glidepath not coincident (VGSI Angle 3.50/TCH 31).

500 2100 EVRGD

GECEB 1800 047° 1500 FLYQT RW05

GP 3.50° TCH 40

2 NM 3.9 NM

CATEGORY	A	B	C	D
RNP 0.15 DA		312-1	304 (400-1)	
RNP 0.30 DA		396-1½	388 (400-1½)	

AUTHORIZATION REQUIRED

ELEV 8 TDZE 8

Diagram of RWY 5 with 500 x 100 and 6000 x 150 markings, TWR, and 047° heading.

REIL Rwy 5, 14, 23 and 32 0
MIRL Rwy 5-23 and 14-32 0