

|         |          |       |
|---------|----------|-------|
| APP CRS | Rwy Ldg  | 11200 |
| 050°    | TDZE     | 747   |
|         | Apt Elev | 796   |

RNAV (RNP) Z RWY 5L

INDIANAPOLIS INTL (IND)

▼


For uncompensated Baro-VNAV systems, procedure NA below -18°C (0°F) or above 54°C (130°F). GPS required. For inop ALS, increase RNP 0.30 all Cats visibility to 1½ SM. Simultaneous approach authorized.

ALS-2

MISSED APPROACH:

Climbing left turn to 3000 direct KEADY and hold.

|        |                      |             |         |              |       |
|--------|----------------------|-------------|---------|--------------|-------|
| D-ATIS | INDIANAPOLIS APP CON | INDY TOWER  | GND CON | CLNC DEL     | CPDLC |
| 134.25 | 128.175 317.8        | 120.9 251.1 | 121.9   | 128.75 251.1 |       |

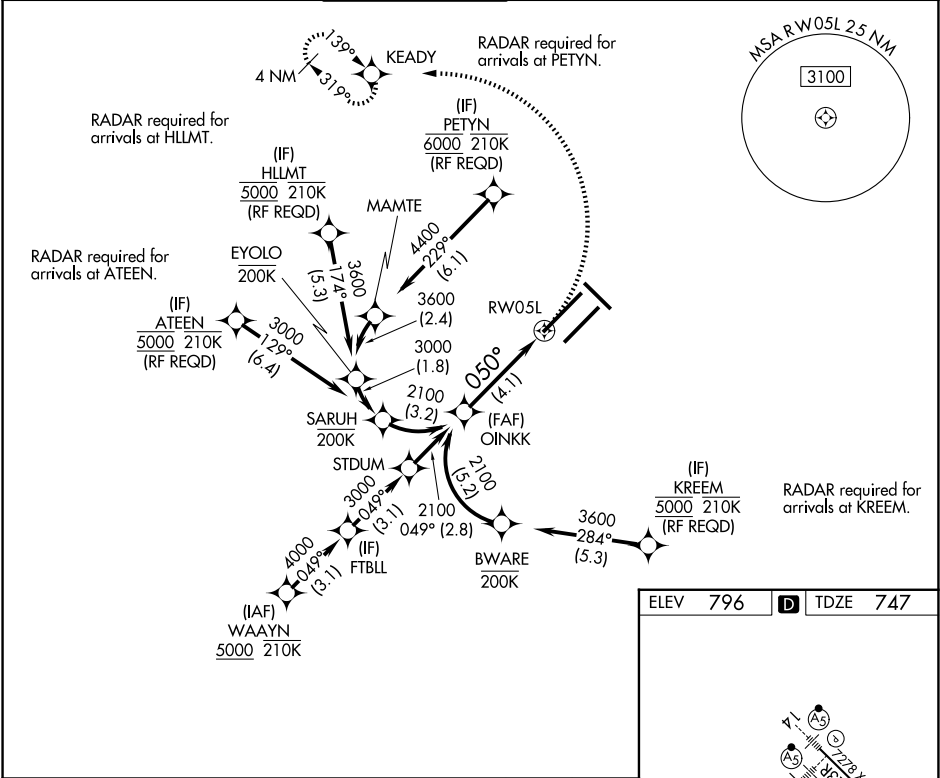

OINKK

2100

GP 3.00° TCH 53

2100

050°

See planview for multiple IF locations.

4.1 NM

RW05L

VGSI and RNAV glidepath not coincident (VGSI Angle 3.00/TCH 74).

3000

KEADY

ELEV 796

TDZE 747

050°

0.5° DOWN

1200 X 150

2200 X 150

2400 X 150

2600 X 150

2800 X 150

3000 X 150

3200 X 150

3400 X 150

3600 X 150

3800 X 150

4000 X 150

4200 X 150

4400 X 150

4600 X 150

4800 X 150

5000 X 150

5200 X 150

5400 X 150

5600 X 150

5800 X 150

6000 X 150

6200 X 150

6400 X 150

6600 X 150

6800 X 150

7000 X 150

7200 X 150

7400 X 150

7600 X 150

7800 X 150

8000 X 150

8200 X 150

8400 X 150

8600 X 150

8800 X 150

9000 X 150

9200 X 150

9400 X 150

9600 X 150

9800 X 150

10000 X 150

050°

CATEGORY

A

B

C

D

RNP 0.30 DA

1197/60

450 (500-1¼)

AUTHORIZATION REQUIRED

HIRL all Rwys

TDZ/CL Rwys 5L and 5R