

APP CRS	Rwy Ldg	6995
024°	TDZE	55
	Apt Elev	55

RNAV (RNP) Z RWY 2

KAHULUI (OGG)(PHOG)

RNP AR APCH - GPS.


▼

For uncompensated Baro-VNAV systems, procedure NA below 14°C or above 54° C. When local altimeter setting not received, procedure NA. For inop ALS, increase RNP 0.30 all Cats visibility to ½ SM.

MALSR

MISSED APPROACH: Climb to 3000 direct KRANE and hold.

ATIS	HCF APPROACH	MAUI TOWER★	GND CON	UNICOM
128.6	120.2 322.4 (N) 119.5 225.4 (S)	118.7 (CTAF) 0 279.6	121.9 279.6	122.95

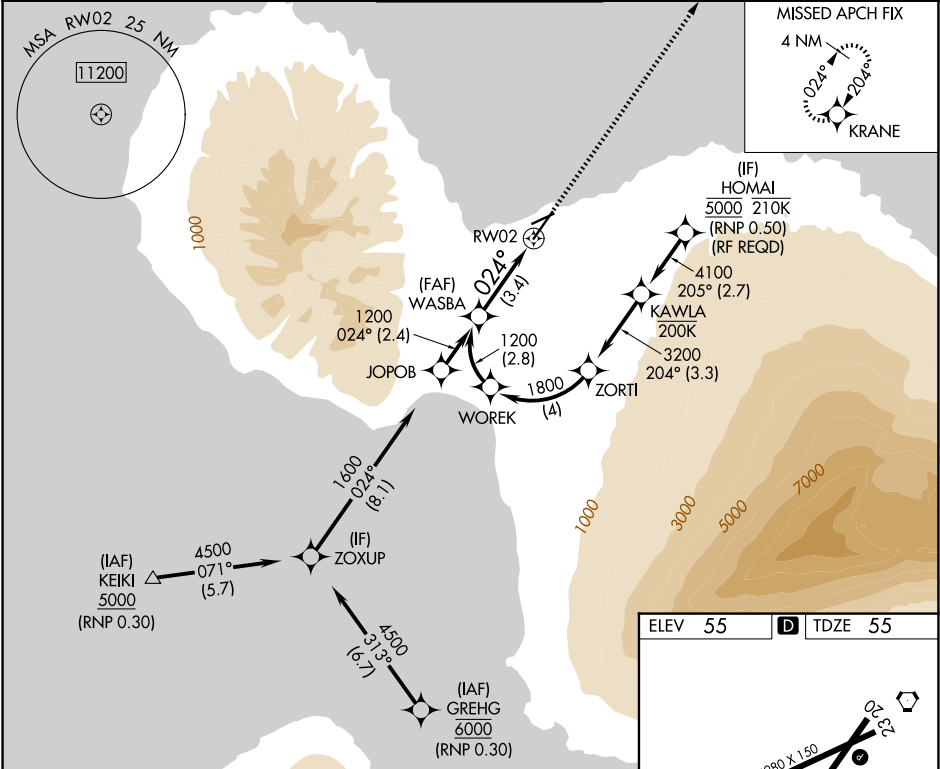

WASBA

1200

GP 3.00°

TCH 62

3.4 NM

024°

RW02

3000

KRANE

See planview for multiple IF locations.

VGSI and RNAV glidepath not coincident (VGSI Angle 3.00/TCH 77).

CATEGORY	A	B	C	D
RNP 0.30 DA	394-½ 339 (400-½)			

AUTHORIZATION REQUIRED

ELEV 55

TDZE 55

4980 X 150

0.6% UP

6995 X 150

024°

TWR

AS

H

HIRL Rwy 2-20

MIRL Rwy 5-23

PAC, 03 SEP 2026 to 29 OCT 2026

PAC, 03 SEP 2026 to 29 OCT 2026