

APP CRS

Rwy Ldg

058°

TDZE

27

Apt Elev

30

RNAV (RNP) Z RWY 6

SOUTHWEST FLORIDA INTL (RSW)


RNAV AR APCH - GPS.

MALSR

For uncompensated Baro-VNAV systems, procedure NA below 4°C or above 54°C.

MISSED APPROACH: Climb to 500 then climbing right turn to 2300 direct CORFU and hold, continue climb-in-hold to 2300.

D-ATIS	FORT MYERS APP CON★	FORT MYERS TOWER★	GND CON	UNICOM
124.65	125.15 306.2 (6) 126.8 306.2 (24)	128.75 (CTAF) 0 257.8	121.9 257.8	122.95

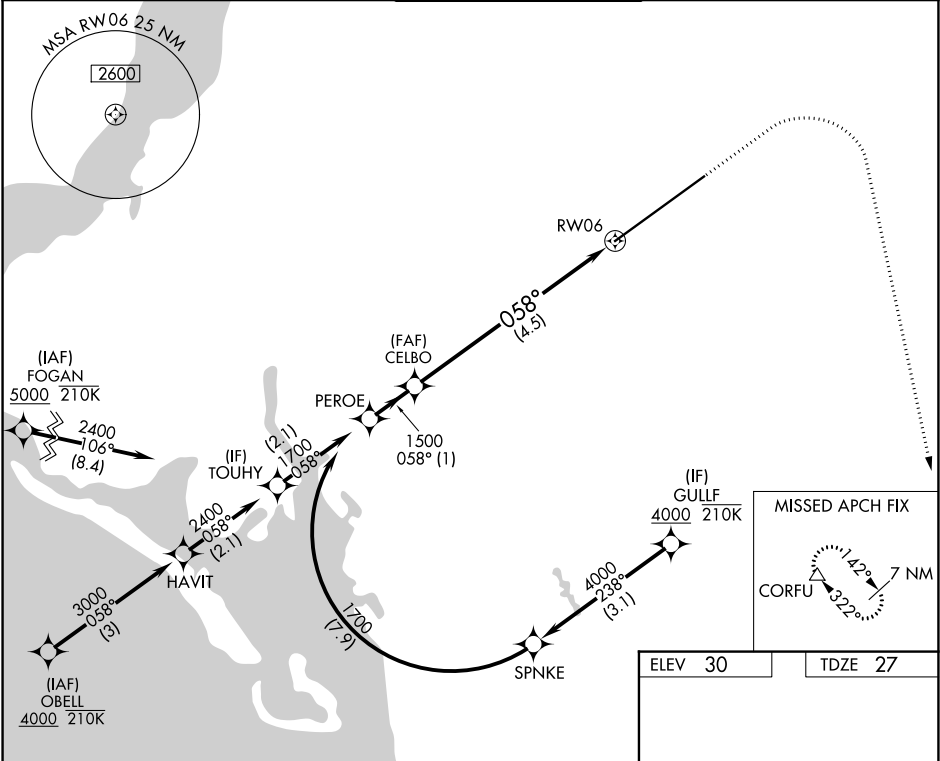

PEROE

GP 3.00°
TCH 55

1700

058°

1500

1500

1 NM

4.5 NM

RW06

See Planview for multiple IF locations.

500

2300

CORFU

VGSI and RNAV glidepath not coincident (VGSI Angle 3.00/TCH 69).

12000 X 1.50

TWR

058°

REIL Rwy 24

TDZL/RCLS Rwy 6

HIRL Rwy 6-24

CATEGORY	A	B	C	D
RNP 0.11 DA		296/24	269 (300-½)	
RNP 0.30 DA		375/30	348 (400-⅝)	

AUTHORIZATION REQUIRED