RNAV (GPS) RWY 23

WILLOW RUN (YIP)

WAAS	APP CRS	Rwy Ldg	7543
CH 65744	233°	TDZE	710
W23A		Apt Elev	716


RNP APCH - GPS.

For uncompensated Baro-VNAV systems, procedure NA below -19°C or above 54°C. For inop ALS, increase LNAV/VNAV all Cats visibility to ⅞ SM, LNAV Cats C/D visibility to 1 SM.


MALSR


MISSED APPROACH: Climb to 3000 direct ZAVEX and hold, continue climb-in-hold to 3000.

ATIS	DETROIT APP CON	WILLOW RUN TOWER	GND CON
127.425	118.95 284.0	125.275 256.9	119.975

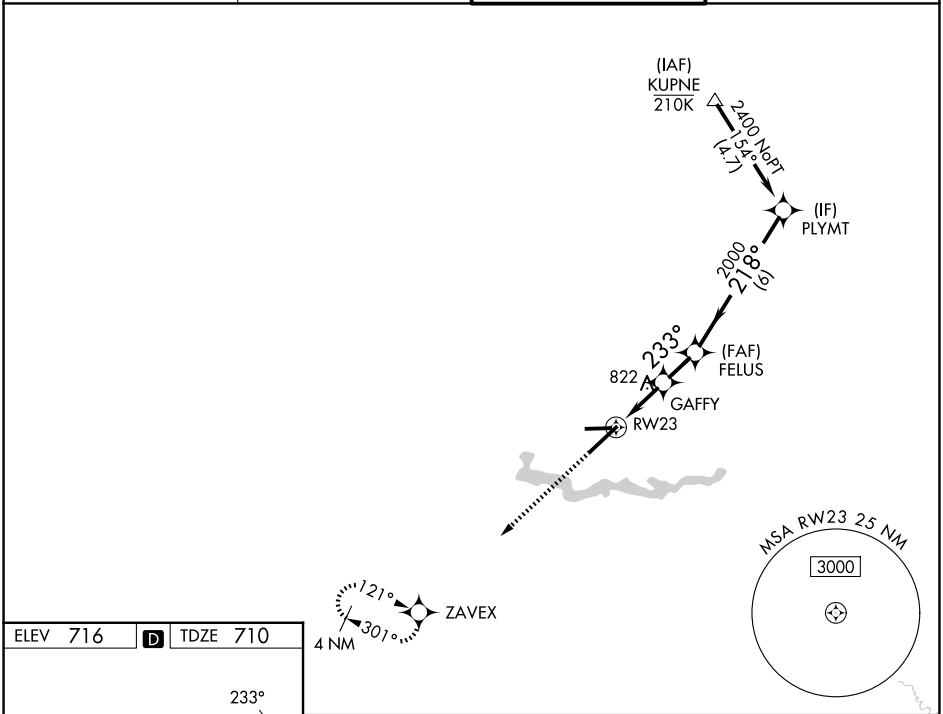

ELEV 716 D TDZE 710

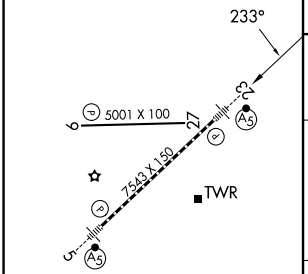

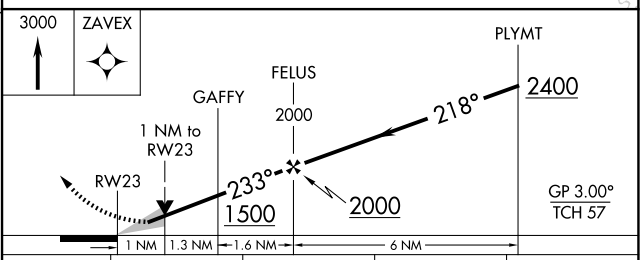

CATEGORY	A	B	C	D
LPV DA	910-½ 200 (200-½)			
LNAV/VNAV DA	982-½ 272 (300-½)			
LNAV MDA	1080-½ 370 (400-½)		1080-⅝ 370 (400-⅝)	
CIRCLING	1220-1 504 (600-1)		1220-1½ 504 (600-1½)	1400-2¼ 684 (700-2¼)

TDZ/CL Rwy 5
HIRL Rwy 5-23
MIRL Rwy 9-27

EC-1, 26 NOV 2026 to 24 DEC 2026
EC-1, 26 NOV 2026 to 24 DEC 2026